ENVISION

NDW 8 to 15 Ton Hydronic Unit

Installation Information

Water Piping Connections

Electrical Data

Microprocessor Control

Startup Procedures

Preventive Maintenance








Table of Contents

Model Nomenclature
General Installation Information
Water Quality
Field Connected Water Piping5-6
NDW Typical Application Piping
Electrical Data 8
Wiring Schematic 9-1
Field Wiring and Control Setup
Control Features
Sequence of Operation16
Inputs and Outputs Configuration
Networking Protocol
Unit Display and Interface
Physical Data
AHRI Data
Reference Calculations
Legend and Notes
Performance Data
Operating Parameters
Load and Source Pressure Drop
Unit Startup
Troubleshooting
Preventive Maintenance
Service Parts List





Model Nomenclature

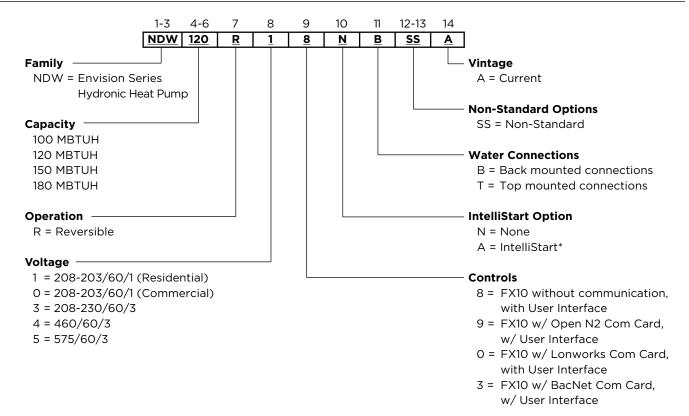

NOTE: *IntelliStart available only on 208-230/60/1 units.

3/9/09

General Installation Information

Safety Considerations

Installing and servicing air conditioning and heating equipment can be hazardous due to system pressure and electrical components. Only trained and qualified service personnel should install, repair or service heating and air conditioning equipment. When working on heating and air conditioning equipment, observe precautions in the literature, tags and labels attached to the unit and other safety precautions that may apply.

Follow all safety codes. Wear safety glasses and work gloves. Use quenching cloth for brazing operations. Have fire extinguisher available for all brazing operations.

NOTE: Before installing, check voltage of unit(s) to ensure proper voltage.



WARNING: Before performing service or maintenance operations on the system, turn off main power switches to the unit. Electrical shock could cause serious personal injury.

Application

Units are not intended for heating domestic (potable) water by direct coupling. If used for this type of application, a secondary heat exchanger must be used.

Moving and Storage

Move units in the normal "Up" orientation as indicated by the labels on the unit packaging. When the equipment is received, all items should be carefully checked against the bill of lading to ensure that all crates and cartons have been received in good condition. Examine units for shipping damage, removing unit packaging if necessary to properly inspect unit. Units in question should also be internally inspected. If any damage is observed, the carrier should make the proper notation on delivery receipt acknowledging the damage. Units are to be stored in a location that provides adequate protection from dirt, debris and moisture.



WARNING: To avoid equipment damage, do not leave the system filled in a building without heat during cold weather, unless adequate freeze protection levels of antifreeze are used. Heat exchangers do not fully drain and will freeze unless protected, causing permanent damage.

Unit Location

Provide sufficient room to make water and electrical connections. If the unit is located in a confined space, provisions must be made for unit servicing. Locate the unit in an indoor area that allows easy removal of the access panels and has enough space for service personnel to perform maintenance or repair. These units are not approved for outdoor installation and, therefore, must be installed inside the structure being conditioned. Do not locate units in areas subject to freezing conditions.




WARNING: Do not store or install units in corrosive environments or in locations subject to temperature or humidity extremes (e.g. attics, garages, rooftops, etc.). Corrosive conditions and high temperature or humidity can significantly reduce performance, reliability, and service life.



WARNING: To avoid equipment damage and possible voiding of warranty, be sure that properly sized strainers are installed upstream of both brazed plate heat exchangers to protect them against particles in the fluid.

Mounting Units

Units should be mounted level on a vibration absorbing pad slightly larger than the base to provide isolation between the unit and the floor. It is not necessary to anchor the unit to the floor. Allow access to the front, back, and side access panels for servicing.



Vibration Pad Mounting

Water Quality

General

NDW systems may be successfully applied in a wide range of residential, commercial, and industrial applications. It is the responsibility of the system designer and installing contractor to ensure that acceptable water quality is present and that all applicable codes have been met in these installations.

Water Treatment

Do not use untreated or improperly treated water. Equipment damage may occur. The use of improperly treated or untreated water in this equipment may result in scaling, erosion, corrosion, algae or slime. The services of a qualified water treatment specialist should be engaged to determine what treatment, if any, is required. The product warranty specifically excludes liability for corrosion, erosion or deterioration of equipment.

The heat exchangers in the units are 316 stainless steel plates with copper brazing. The water piping in the heat exchanger is steel. There may be other materials in the building's piping system that the designer may need to take into consideration when deciding the parameters of the water quality.

If an antifreeze or water treatment solution is to be used, the designer should confirm it does not have a detrimental effect on the materials in the system.

Contaminated Water

In applications where the water quality cannot be held to prescribed limits, the use of a secondary or intermediate heat exchanger is recommended to separate the unit from the contaminated water.

The following table outlines the water quality guidelines for unit heat exchangers. If these conditions are exceeded, a secondary heat exchanger is required. Failure to supply a secondary heat exchanger where needed will result in a warranty exclusion for primary heat exchanger corrosion or failure.

Strainers

These units must have properly sized strainers upstream of both brazed plate heat exchangers to protect them against particles in the fluid. Failure to install proper stainers and perform regular service can result in serious damage to the unit, and cause degraded performance, reduced operating life and failed compressors. Improper installation of the unit (which includes not having proper strainers to protect the heat exchangers) can also result in voiding the warranty.

Field supplied strainers with 20-40 mesh (530-1060 microns) are recommended, with 30 mesh (800 microns) being the optimum choice. The strainers selected should have a mesh open area of at least 6 square inches (39 square centimeters) for each unit being serviced by the strainer. Using strainers with a smaller amount of open area will result in the need for more frequent cleaning.

Strainers should be selected on the basis of acceptable pressure drop, and not on pipe diameter. The strainers selected should have a pressure drop at the nominal flow rate of the units low enough to be within the pumping capacity of the pump being used.



WARNING: Must have intermediate heat exchanger when used in pool applications.

Water Quality Guidelines

Material		Copper	90/10 Cupro-Nickel	316 Stainless Steel
pН	Acidity/Alkalinity	7- 9	7 - 9	7 - 9
Scaling	Calcium and Magnesium Carbonate	(Total Hardness) less than 350 ppm	(Total Hardness) less than 350 ppm	(Total Hardness) less than 350 ppm
	Hydrogen Sulfide	Less than .5 ppm (rotten egg smell appears at 0.5 PPM)	10 - 50 ppm	Less than 1 ppm
	Sulfates	Less than 125 ppm	Less than 125 ppm	Less than 200 ppm
	Chlorine	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Chlorides	Less than 20 ppm	Less than125 ppm	Less than 300 ppm
	Carbon Dioxide	Less than 50 ppm	10 - 50 ppm	10- 50 ppm
Corrosion	Ammonia	Less than 2 ppm	Less than 2 ppm	Less than 20 ppm
	Ammonia Chloride	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Ammonia Nitrate	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Ammonia Hydroxide	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Ammonia Sulfate	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Total Dissolved Solids (TDS)	Less than 1000 ppm	1000-1500 ppm	1000-1500 ppm
	LSI Index	+0.5 to05	+0.5 to05	+0.5 to05
Iron Fouling	Iron, Fe ² + (Ferrous) Bacterial Iron Potential	< .2 ppm	< .2 ppm	< .2 ppm
(Biological Growth)	Iron Oxide	Less than 1 ppm. Above this level deposition will occur.	Less than 1 ppm. Above this level deposition will occur.	Less than 1 ppm. Above this level deposition will occur.
Erosion	Suspended Solids	Less than 10 ppm and filtered for max of 600 micron size	Less than 10 ppm and filtered for max of 600 micron size	Less than 10 ppm and filtered for max 600 micron size
	Threshold Velocity (Fresh Water)	< 6 ft/sec	< 6 ft/sec	< 6 ft/sec

Grains = PPM divided by 17 • mg/l is equivalent to PPM

Field Connected Water Piping

General

Each unit is equipped with captive 2 in. [50.8 mm] FPT water connections to eliminate 'egg-shaping' from use of a backup wrench. For making the water connections to the unit, a Teflon tape thread sealant is recommended to minimize internal fouling of the piping. Do not over tighten connections.

NOTE: Units are factory run-tested using propylene glycol. Prior to connecting piping to unit, thoroughly flush heat exchangers.

The piping installation should provide service personnel with the ability to measure water temperatures and pressures. The water lines should be routed so as not to interfere with access to the unit. The use of a short length of high pressure hose with a swivel type fitting may simplify the connections and prevent vibration. Optional stainless steel hose kits are available as an accessory item.

Before final connection to the unit, the supply and return hose kits must be connected, and the system flushed to remove dirt, piping chips and other foreign material. Normally, a combination balancing and close-off (ball) valve is installed at the return, and a rated gate or ball valve is installed at the supply. The return valve can be adjusted to obtain the proper water flow. The valves allow the unit to be removed for servicing. Both source as well as load fluid piping must be at least as large as the unit connections on the heat pump (larger on long runs).

Never use flexible hoses of a smaller inside diameter than that of the water connection on the unit and limit hose length to 10 ft. per connection. Check carefully for water leaks.

Load and Source Piping Connections

The NDW Series has two connection options available. Each kit is intended to connect one piping connection. Therefore, two kits will be required for each unit. The kits can be mixed for installer convenience, one on source and the other on load.

CKNDW1 - Strainer Connection Kit includes a 2" copper tee with integral P/T plug and a 2" "Y" strainer. Other components to complete the all copper piping can be sourced locally.

HHK162S - Strainer Hose Kit set includes 2" Hose kit includes a 2" stainless steel braided hose with integral P/T plug and 2" "Y" strainer.



HHK162S

CKNDW1

Water Flow Rate

The proper water flow must be delivered to each unit whenever the unit heats or cools. To assure proper flow, the use of pressure/temperature ports is recommended to determine the flow rate. These ports should be located adjacent to the supply and return connections on the unit. The proper flow rate cannot be accurately set without measuring the water pressure drop through the refrigerant-to-water heat exchanger (See Pressure Drop Table for water flow and pressure drop information).

Load Flow Rate

The load flow on all water to water products including the NDW Series should be 3 gpm per ton (typically the rated flow and the highest flow shown in the capacity charts). Refer to the table below. This flow rate is required especially when heating water to limit the effects of the higher condensing temperatures of water heating for radiant floor heating or domestic water use.

Source Flow Rate

The source flow can range between 2.25 and 3 gpm per ton for earth loops. For open loop well water systems the minimum flow should be 1.5 gpm per ton. In earth loop systems where entering water temperatures are expected to be above 95°F, 3 gpm per ton should be used. In well systems where the water temperature is below 50°F, 2 gpm per ton should be used to avoid nuisance freeze detection trips.

		Load				
	Minimum Open Loop	Open Loop < 50°F	Closed Loop Range (Min - Full Flow)		Flow Rate	
NDW100	15	20	23	30	30	
NDW120	18	24	27	36	36	
NDW150	21	28	32	42	42	
NDW180	24	32	36	48	48	

Flushing

Flushing the system of debris is especially important in brazed plate heat exchanger systems. These systems have many small parallel flow paths in which debris can clog. Initial flushing of the system can be accomplished in one of two ways. First flushing the piping system as shown (pages 6-7) toward the strainer will allow the strainers to capture all debris prior the heat exchangers and commissioning. Secondly a temporary bypass can be included in the piping design so that the heat pump itself can be bypassed during the initial flushing stage with an external strainer gathering the debris.



CAUTION: Water piping exposed to outside temperature may be subject to freezing.

Field Connected Water Piping cont.

Closed Loop Tower/Boiler Systems

The water loop is usually maintained between 60°F [15.5°C] and 90°F [32.2°C] for proper heating and cooling operation. This is accomplished with a cooling tower and a boiler.

To reject excess heat from the condenser water loop, the use of a closed-circuit evaporative cooler or an open type cooling tower with a secondary heat exchanger between the tower and the condenser water loop is recommended. If an open type cooling tower is used without a secondary heat exchanger, continuous chemical treatment and filtering of the water must be performed to ensure the water is free from damaging materials.



CAUTION: Water piping exposed to outside temperature may be subject to freezing.

Open Loop Well Water Systems

Installation of an open loop system is not recommended unless water quality guidelines are met.

Earth Coupled Systems

All supply and return water piping should be insulated to prevent excess condensation from forming on the water lines. Ensure pumping system is capable of providing adequate flow rate at the system pressure drop, 3.0 GPM per ton [0.054 LPS per kW] (source side) is recommended. Antifreeze in the loop is strongly recommended.


Heating with High Source Temperatures

Heating water with a water to water unit using high source temperatures can lead to operating conditions that fall outside of the system operating range. The condition occurs when the loop (source) temperature exceeds 70°F [21.1°C] with a full flow of 3 GPM per ton [0.054 LPS per kW]. Under this scenario, the evaporating temperature can fall outside of the compressor operating window.


To allow the system to operate correctly, restricting the source side flow when the evaporating temperature exceeds 55°F [12.7°C] is recommended. One way of accomplishing this is to use a flow-restricting valve on the source loop circuit that is controlled by the evaporating temperature. Locate the sensing device on the refrigerant inlet of the evaporator. In dual circuit systems, the company recommends monitoring both circuits and controlling off the sensor that reads the highest temperature.

As an alternative to the evaporating temperature, the suction line temperature can be monitored with the same control capability. In this control, temperature should be a maximum of 65°F [18.3°C].


A kit is available for this application, contact WaterFurnace for support.



Closed Loop (Boiler/Tower) Systems

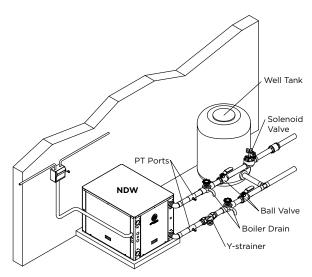


Open Loop Well Water Systems



Earth Coupled Systems

NDW Typical Application Piping

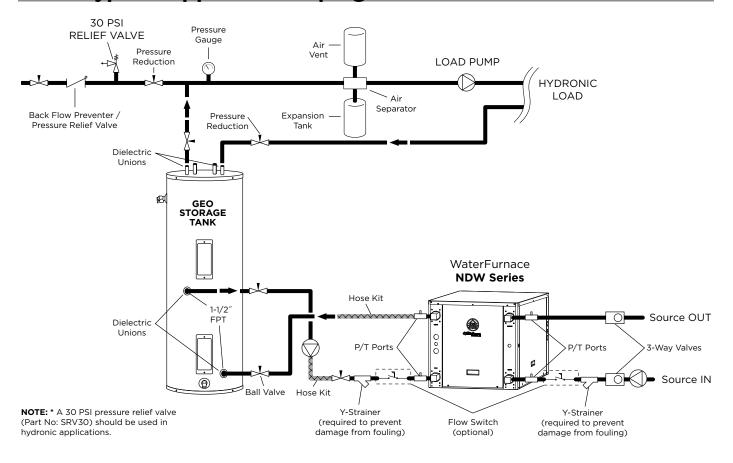


Electrical Data

Model		Supply	Rated	Pated	Voltage		Comp	ressor*		Load	Source	Total	Min	Max
	Circuit Voltage		мсс	RLA	LRA	LRA**	Pump FLA	Pump FLA	Unit FLA	Circ Amp	Fuse/ HACR			
	L1/L2	208-230/60/1	187/253	41.2	26.4	134.0	47.0	-	-	26.4	33.0	50		
[L3/L4	208-230/60/1	187/253	41.2	26.4	134.0	47.0	4.2	4.2	34.8	41.4	60		
100	Single	208-230/60/3	187/253	24.9	16.0	110.0	-	-	-	32.0	36.0	50		
[Single	460/60/3	414/506	12.1	7.8	52.0	-	-	-	15.6	17.6	25		
	Single	575/60/3	517/633	8.9	5.7	38.9	-	-	-	11.4	12.8	15		
	L1/L2	208-230/60/1	187/253	47.0	30.1	145.0	51.0	-	-	30.1	37.6	60		
ſ	L3/L4	208-230/60/1	187/253	47.0	30.1	145.0	51.0	4.2	4.2	38.5	46.0	70		
120	Single	208-230/60/3	187/253	28.0	17.3	120.0	-	-	-	34.6	38.9	50		
ĺ	Single	460/60/3	414/506	15.0	9.6	70.0	-	-	-	19.2	21.6	30		
	Single	575/60/3	517/633	12.5	8.0	53.0	-	-	-	16.0	18.0	25		
	L1/L2	208-230/60/1	187/253	42.0	26.9	145.0	51.0	-	-	26.9	33.6	60		
[L3/L4	208-230/60/1	187/253	42.0	26.9	145.0	51.0	4.2	4.2	35.3	42.0	60		
150	Single	208-230/60/3	187/253	35.0	22.4	190.0	-	-	-	44.8	50.4	70		
ſ	Single	460/60/3	414/506	19.0	12.2	87.0	-	-	-	24.4	27.5	30		
	Single	575/60/3	517/633	15.0	9.6	62.0	-	-	-	19.2	21.6	30		
	L1/L2	208-230/60/1	187/253	50.0	32.1	185.0	65.0	-	-	32.1	40.1	70		
[L3/L4	208-230/60/1	187/253	50.0	32.1	185.0	65.0	4.2	4.2	40.5	48.5	80		
180	Single	208-230/60/3	187/253	39.0	26.0	190.0	-	-	-	52.0	58.5	80		
[Single	460/60/3	414/506	19.0	13.0	100.0	-	-	-	26.0	29.3	40		
ĺ	Single	575/60/3	517/633	14.5	9.3	72.0	-	-	-	18.6	20.9	30		

HACR circuit breaker in USA only


Figure 1 - Control Box

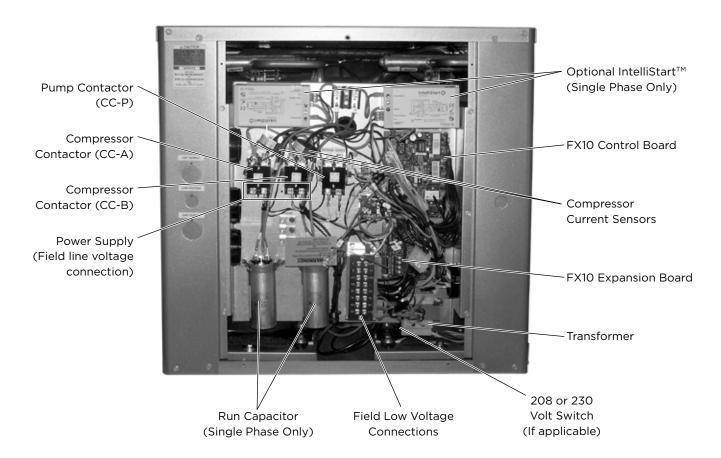


^{*} Ratings per each compressor - unit supplied with two ** With optional IntelliStart (single phase only)

Wiring Schematics



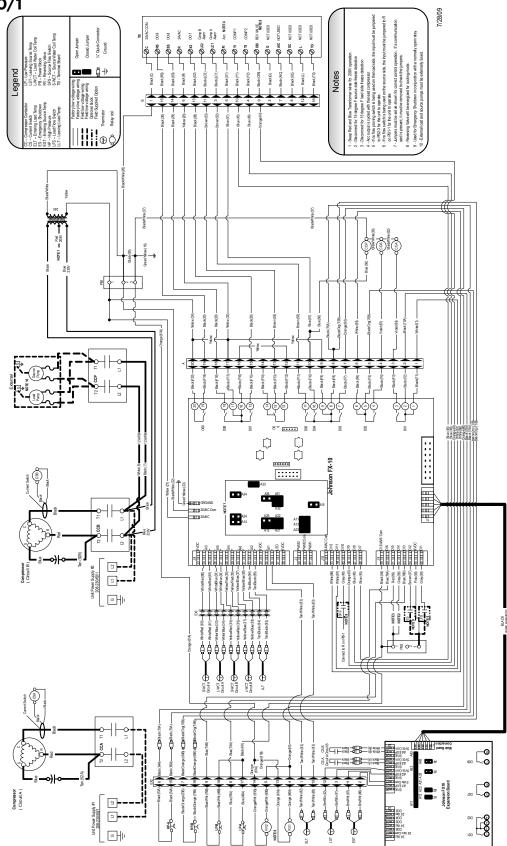


Wiring Schematics cont.

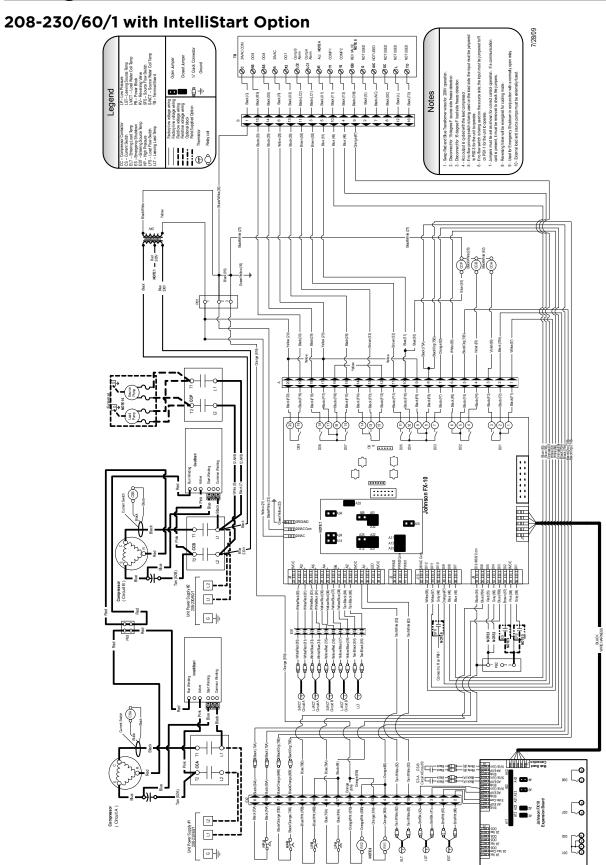

Wiring Schematics cont.

460/60/3

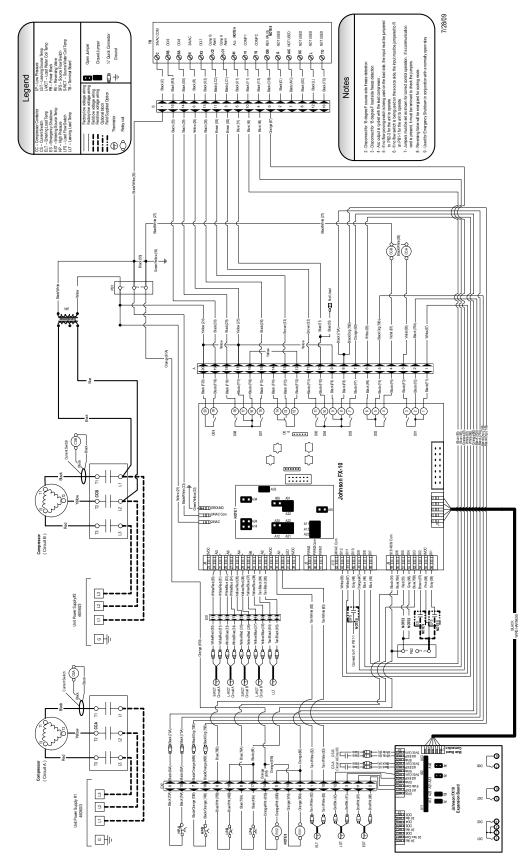

Field Wiring and Control Setup

Figure 2 - High Voltage Connections


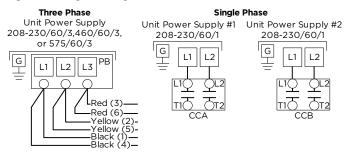



Figure 3 - Low Voltage Connections



NOTES:

Acc Output 1 is cycled with the lead compressor
 Acc Output 2 is cycled with the lag compressor

Figure 4 - Wiring Schematic

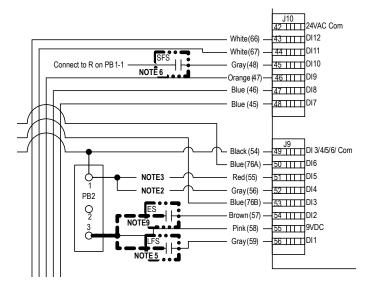

Line Voltage

High Voltage Connections

Connect power wiring as shown in Figure 2.

208 Volt Operation

Switch red and blue transformer wires for 208V operation.

Low Voltage Operation

Thermostat/Controller (Aquastat)

A two-stage 24 VAC thermostat or liquid controller (field supplied) must be used to turn the NDW on or off, and to switch it from cooling to heating if necessary. Multiple NDWs in the same bank must be controlled from one thermostat/controller (must be isolation relays for multiple unit applications).

Low Voltage Connections

Connect low voltage thermostat wiring as shown in Figure 3. Connections shown are for typical thermostat. Actual connections may vary with specific device used.

NOTE: If a separate transformer is used to supply a Y1, Y2, or B signal to the unit controls, isolation relays must be used.



CAUTION: Use only copper conductors for field installed wiring. Terminals in the unit are not designed for other types of conductors.



WARNING: All wiring must comply with local and state codes. Disconnect the power supply before beginning to wire to prevent electrical shock or equipment damage.

NOTE: Accessory output is selectable as normally open or normally closed using the unit display. Normally closed is the factory default setting.

Source Flow Switch (SFS)

Unit is factory shipped with jumpers on the Source Flow Switch pins J10-45 (entering). Flow proving switch is optional, hook up as shown in Fig. 4 and Note 6. The unit will not operate without a flow proving switch or jumper installed.

Load Flow Switch (LFS)

Unit is factory shipped with jumpers on the Load Flow Switch pins J9-56 (leaving). Flow proving switch is optional, hook up as shown in Fig. 4 and Note 5. The unit will not operate without a flow proving switch or jumper installed.

Load and Source Pump

The load or source pump connection allows for 4.2 A at 208/60/1 on each (208/60/1 models only). This pump supply should be adequate for most applications. Please consult the electrical schematic and table for more detail.

Field Wiring and Control Setup cont.

Accessory Relay Setup

The accessory output set to "close" upon Y1 compressor call (compressor is delayed 90 sec. after Y1) but can be set to "open" with Y1.

To change ACC1:

- On FX10 control using the left and right arrow keys, scroll to "PASSWORD" menu (password "5667")
- Once you have entered the password scroll to "MAINT" menu.
- · Using up and down keys, scroll to "Acc 1 Sel" hit "ENTER" and "ON Comp" begins flashing
- · Using up and down keys, select "ON Comp" for activation with Y1 Call or "OFF Comp" for deactivation with Y1

Lead/Lag Selection

Compressor Lead/Lag Selection is factory set to "OFF" but can be set to "ON".

To change Lead/Lag On/Off:

- On FX10 control using the left and right arrow keys, scroll to "PASSWORD" menu (password "5667")
- Once you have entered the password scroll to "MAINT" menu
- Using up and down keys, scroll to "LEAD/LAG SELECT" hit "ENTER" and "OFF" begins flashing
- Using up and down keys, select "ON" for activation or "OFF" for deactivation

Lead/Lag Time - Runtime in Hours

Compressor Lead/Lag Time is factory set "24" hours but can be set from 1 to 100 hours.

To change Lead/Lag Time:

- On FX10 control using the left and right arrow keys, scroll to "PASSWORD" menu (password "5667")
- Once you have entered the password scroll to "MAINT" menu.
- Using up and down keys, scroll to "LEAD/LAG TIME" hit "ENTER" and "LEAD/LAG TIME begins flashing
- Using up and down keys, select 1 100 HOURS.

°F or °C - Unit of Measure

Degrees Fahrenheit is factory set, however degrees Celsius can be selected using the following procedure:

To Change Unit of Measure:

- On FX10 control using up and down keys, scroll to "SETTINGS"
- Using up and down keys, scroll to "UNIT OF MEASURE" hit "ENTER" and "UNIT OF MEASURE" begins flashing
- Using up and down keys, select "F" for degrees Fahrenheit or "C" for degrees Celsius

Other Field Options

Other field selectable options are available as shown in the maintenance menu on page 14 of the FX10 control using a similar procedure as shown in the above examples. These would include thermostat enabling, and emergency shutdown. See page 14 for details.

DDC Operation and Connection

Consult AGFX10 Manual for application details.

Control Features

Anti Short Cycle
High Pressure Protection
Low Pressure Protection
Advanced Freeze Detection Setpoint
Random Start
Display for diagnostics
Reset Lockout at disconnect
Intelligent reset for field installed flow switches
1 Accessory output
Optional DDC control add-on
Compressor Lead/Lag
Compressor Current Switches

Field Selectable Options Freeze Detection Sensing Select (DI-4 and DI-5)

The freeze detection temperature sensing selection inputs allow the user to adjust the setpoints. The source sensors are wired to inputs Al-3 and Al-4 while the load sensors are wired to inputs Al-5 and Al-6. The setpoints for both, the load and source, are factory set for 30°F. In order to change the setpoint to 15°F on the source, remove the jumper wire from Dl-4 (wire #56). The load setpoint can be changed by removing the jumper wire from Dl-5 (wire #55).

Accessory Output (DO-4)

The accessory Output will be energized 90 seconds prior to the lead compressor output being energized. When the lead compressor output is turned off the accessory output will be deactivated immediately. The output is selectable for normally open or normally closed operation through the unit mounted user interface or from a building automation system.

Control and Safety Features Emergency Shutdown

The emergency shutdown mode can be activated by a command from a facility management system or a closed contact on DI-2. The default state for the emergency shutdown data point is off. When the emergency shutdown mode is activated, all outputs will be turned off immediately and will remain off until the emergency shutdown mode is deactivated. The first time the compressor starts after the emergency shutdown mode has been deactivated, there will be a random start delay present.

Lockout Mode

Lockout mode can be activated by any of the following fault signals: refrigerant system high pressure, refrigerant system low pressure, heating freeze detection, cooling freeze detection, and compressor current sensor. When any valid fault signal remains continuously active for the length of its recognition delay, the controller will go into fault retry mode, which will turn off the compressor. After the Compressor short cycle delay, the compressor will attempt to operate once again. If three consecutive faults are recognized during a single heating or cooling demand, the unit will go into lockout mode, turning off the compressor and enabling the alarm output until the controller is reset.

The fault count will automatically reset when the heating or cooling command becomes satisfied. If a fault occurs on a dual compressor unit, the other compressor will continue to operate based on the heating or cooling demand. The lockout condition can be reset by powering down the controller, by a command from the facility management system, or by holding both the enter and escape keys on the optional user interface.

Advanced Freeze Detection System

The NDW source and load heat exchangers are protected by a multi-sourced temperature logic strategy. The temperature logic is based upon the refrigerant temperature sensed as the refrigerant is about to enter the heat exchanger; while entering and leaving water temperatures are being used as correlating factors. The detection scheme is shown as basic and advanced algorithms.

Basic Freeze Detection Operation: "Comp1 or Comp2 Freeze" Alarm

This alarm can be triggered by one of two detection schemes.

Hard Limit Freeze Detection

If the refrigerant temperature drops below the freeze detection setpoint by 1.8°F, the associated compressor is locked out immediately regardless of any other factors and requires a manual reset. **NOTE: This Lockout produces a "Comp 1 or Comp 2 Freeze" error on the MUI display.**

Freeze Detection

The refrigerant temperature is compared to the freeze detection setpoint (15°F [antifreeze] or 33°F [water] field selectable), and if the temperature falls below the setpoint for 30 continuous seconds, the associated compressor will be halted. This function becomes enabled after the first two minutes of compressor operation. Three such events in 60 minutes will trigger a compressor lockout that requires a manual reset. **NOTE:**

This Lockout produces a "Comp 1 or Comp 2 Freeze" error on the MUI display.

In addition to the above:

Entering Water Temperature Influence
If the entering water temperature of the evaporative heat exchanger is within 10°F of the freeze setpoint, the previously mentioned two minute delay will be eliminated. This allows the freeze detection to operate immediately when the compressor starts based on entering water temperature.

Leaving Water Temperature Influence

If the leaving water temperature of the evaporative heat exchanger is within 10°F of the freeze setpoint, the previously mentioned 30 second delay will begin to be proportionately reduced, ending at a 1 second delay when the leaving water temperature is 1.5°F above the freeze setpoint.

Control Features cont.

Dual Circuited Heat Exchanger Protection

A low temperature condition on either refrigerant circuit will prevent the start of both compressors. If the low temperature condition exists for 5 minutes when both compressors are off, a lockout is triggered for both compressors. However, if -for instance-both compressors are operating and circuit 1 experiences a refrigerant temperature below the freeze detection setpoint such that compressor 1 is halted, compressor 2 will not be halted as a result.

Advanced Freeze Detection Operation: "Pre Freeze" Alarm

Predictive freeze condition detection:

If the refrigerant temperature is within 7.2°F of the freeze detection setpoint, the predictive freeze detection algorithm is enabled, and if the logic determines that a freeze condition is likely to happen based on current conditions, the compressor of the involved refrigerant circuit is immediately stopped. Three (3) such events in 60 minutes will trigger a compressor lockout that requires a manual reset. In the absence of such a condition, the compressor is allowed to operate so that the refrigerant temperature may eventually be at the threshold of the freeze detection setpoint. **NOTE: This Lockout produces a "Pre Freeze" detection error on the MUI display.**

Capacity Limiting

If the leaving water temperature drops to 1.8°F above the freeze detection setpoint, the lead compressor is halted. When the leaving water temperature rises to 3.6°F above the freeze detection setpoint, it will be allowed to resume operation. This limiting is allowed to repeat indefinitely. This causes "COMP1 Low Limit" to be displayed on the MUI.

If the leaving water temperature drops to the freeze detection setpoint, the lag compressor is halted. When the leaving water temperature rises to 1.8°F above the freeze detection setpoint, it will be allowed to resume operation. This limiting is allowed to repeat indefinitely. This causes "COMP2 Low Limit" to be displayed on the MUI.

Compressor Current Switch (AI-3 EXP and AI-4 EXP)

The compressor current switch is designed to insure that the compressor is on when the compressor output is energized. This switch is normally open and closes when current is flowing to the compressor. If the compressor fails to start the switch will open. The switch must be open for a continuous 5 seconds for a fault to occur. After 3 faults in 60 minutes the control will put the unit into an alarm state.

Optional Flow Proving Switch (DI-1 and DI-10)

The load and source flow-proving switches are optional and can be field installed. These switches shall be normally open flow switches that will close when the water flow through the heat exchangers reach an acceptable level.

The flow-proving switches must be closed 15 seconds prior to enabling either compressor output (DO-1 and DO-2). If the load flow-proving switch opens at any time both compressor outputs (DO-1 and DO-2) must be disabled immediately.

High Pressure (DI-11 and DI-12)

The high-pressure switches shall be a normally closed (NC) switch that monitors the systems compressor discharge refrigerant pressures. There shall be an individual high pressure switch for each circuit. If the input senses the high-pressure switch is open during the period that the compressor output is enabled, it must shut down the compressor immediately and count the fault. The compressor minimum on time does not apply if the high-pressure switch trips. The compressor will not restart until the short cycle time delay has been satisfied. If the high-pressure fault occurs in one circuit the other compressor will continue to operate based on the heating or cooling demand.

Low Pressure (DI-3 and DI-6)

The low-pressure switches shall be a normally closed (NC) switch that monitors the systems compressor suction line refrigerant pressure. The input shall be checked 15 seconds before compressor start up to insure the pressure switch is closed and then ignored for the first 2 minutes after the compressor output (DO-1 or DO-2) is enabled. If the switch is open continuously for (30) seconds the compressor output for that circuit will be disabled. The compressor will not restart until the short cycle time delay has been satisfied. If a low-pressure fault occurs in one circuit the other compressor will continue to operate based on the heating or cooling demand.

Compressor 1 Alarm Output (DO-5)

The compressor 1 alarm output will be enabled when stage 1 is in the lockout mode and will be disabled when the lockout is reset.

Compressor 2 Alarm Output (DO-6)

The compressor 2 alarm output will be enabled when stage 2 is in the lockout mode and will be disabled when the lockout is reset.

Test Mode

The unit controls system can be put into test mode to eliminate startup delays to aid in trouble shooting. To put the unit into test mode hold the "ESC" and "Down Arrow" keys until LED 8 begins to flash. The control will remain in test mode until power is cycled or after 30 minutes.

Sequence of Operation

Power Fail Restart

When the controller is first powered up, the outputs will be disabled for a random start delay time (See Random Start Delay). The delay is provided to prevent simultaneous starting of multiple heat pumps. Once the timer expires, the controller will operate in the occupied mode until it is commanded to another mode by a facility management system or a remote thermostat. A restart status variable is available for indication of this occurrence.

Random Start Delay

This delay will be used after every power failure, as well as the first time the compressor(s) is started after the control exits the emergency shutdown mode. The default time period for the start delay will be random between 1 and 120 seconds.

Compressor Fixed On Delay Time

The Compressor Fixed On Delay Time will ensure that the compressor output is not enabled for (90) seconds after the control receives a call to start the compressor.

Compressor Minimum On Delay

The compressor minimum on delay will ensure that the compressor output(s) are enabled for a minimum of (2) minute each time the compressor output is enabled. This will apply in every instance except in the event the high-pressure switch is tripped or emergency shutdown, then the compressor output will be disabled immediately.

Compressor Short Cycle Delay Time

The compressor short cycle time delay will ensure that the compressor output will not be enabled for a minimum of five (5) minutes after it is disabled. This allows for the system refrigerant pressures to equalize after the compressor is disabled.

Compressor Stage Lead Lag

The factory setup software, a facility management system, Service/Commissioning Tool, or a user interface can be used to select compressor lead lag option for the compressors. The factory setup software, a facility management system, Service/Commissioning Tool, or a user interface must also be used to select the number of run time hours the compressors will lead before being switched, the factory default will be 24 hours. The two compressors will still be staged depending on load when the lead lag option is enabled.

Heating Cycle

During the heating cycle, the reversing valves will be positioned for heating operation. The thermostat or aguastat will command the reversing valves "Off" for heating. If the compressor short cycle time delay has been satisfied, the lead compressor will turn on after the accessory output has been enabled, the low pressure switches has been verified, and the fixed compressor start delay timer has been satisfied. When heating is no longer required, the compressor will be turned off immediately after the compressor minimum on delay has been satisfied. After the compressor output is turned off, it will remain off for the time specified in the compressor short cycle time delay. If the dual compressor option is selected, the compressors will be sequenced to maintain the heating setpoint. As the temperature drops below the heating setpoint and begins to operate in the heating proportional band, the first stage compressor will be activated. If the first stage compressor is not able to satisfy the heating demand, the second stage compressor will be activated by the thermostat or aquastat. The controller is allowed to operate the heat pump in the heating mode regardless of the outdoor air temperature.

Cooling Cycle

During the cooling cycle, the reversing valves will be positioned for cooling operation. The thermostat or aquastat will command the reversing valves "On" for cooling. If the compressor short cycle time delay has been satisfied, the lead compressor will turn on after the accessory output has been enabled, the low pressure switches has been verified, and the fixed compressor start delay timer has been satisfied. When cooling is no longer required, the compressor will be turned off immediately after the compressor minimum on delay has been satisfied. After the compressor output is turned off, it will remain off for the time specified in the compressor short cycle time delay. If the dual compressor option is selected, the compressors will be sequenced to maintain the cooling setpoint. As the temperature drops below the cooling setpoint and begins to operate in the cooling proportional band, the first stage compressor will be activated. If the first stage compressor is not able to satisfy the cooling demand, the second stage compressor will be activated by the thermostat or aquastat. The controller is allowed to operate the heat pump in the cooling mode regardless of the outdoor air temperature.

Inputs and Outputs Configuration

DUAL STAGE WW			
Input Name	Input	Output Name	Output
Entering Load Water Temperature	Al 1	Compressor 1	DO1
Leaving Load Water Temperature 1	Al 2	Compressor 2	DO2
Source Heating Freeze Detection 1	Al 3	Reversing Valve	DO3
Source Heating Freeze Detection 2	Al 4	Accessory	DO4
Load Cooling Freeze Detection 1	Al 5	Compressor 1 Alarm	DO5
Load Cooling Freeze Detection 2	Al 6	Compressor 2 Alarm	DO6
		Network Output	DO7
Load Flow Proving Switch	DI 1	Network Output	DO8
Emergency Shutdown	DI 2	Network Output	D09
Stage 2 Low Pressure	DI 3		
Source Htg Freeze Detection Select - 30°F	DI 4	Future	PWM1
Load Htg Freeze Detection Select - 30°F	DI 5	Future	PWM2
Stage 1 Low Pressure	DI 6		
Thermostat Y1	DI 7		
Thermostat Y2	DI 8		
Thermostat B	DI 9		
Source Flow Proving Switch	D10		
Stage 1 High Pressure	DI11		
Stage 2 High Pressure	DI12		
XP10 Expansion Card			
Input Name	Input	Output Name	Output
Entering Source Water Temperature	Al 1	Unused	DO 1
Leaving Source Water Temperature 1	Al 2	Unused	DO 2
Current Switch 1 - Compressor 1	Al 3	Unused	DO 3
Current Switch 2 - Compressor 2	Al 4	Unused	DO 4

Networking Protocol

The Johnson FX10 Board is specifically designed for commercial heat pumps and provides control of the entire unit as well as input ports for Open N2, Lontalk and BACnet communications protocols as well as an input port for a user interface. For more information on the specifics of each protocol refer to the application guide AGFX10.

Unit Display and Interface

The Unit Display allows the user to view entering and leaving water temperatures, freeze detection readings, inputs and outputs, and allows the user enable and disable certain control functions through the various menus. The interface also displays all faults on the LCD once the unit has locked out to aid in diagnostics.

There are 10 LED indicator lights that indicate the following:

- Power Shows that the FX processor is operational
- Alarm Lights when there is a lock-out or faulty freeze detection sensor
- 1 Flashing shows Compressor 1 is running
- 2 Flashing shows Compressor 2 is running
- 3 On shows Compressor 2 is lead
- 4 On shows Reversing valve in cool
- 8 On shows unit in 'Test' mode



MUI Menu Navigation for NDW

Welcome

Info Temp Stat Outputs Settings Alarm ALM_History Password Maint

IIIIO					
WFI Envision Dual Compressor Water-to-Water PRODCWWE-06B MM/DD/YY					

Info

Temp								
Temperatures								
Enter Load	77.2°F							
Leave Load	51.0°F							
Enter Source	70.0°F							
Leave Source	66.0°F							
Source Frz1	77.8°F							
Source Frz2	30.0°F							
Load Frz1	30.0°F							
Load Frz2	30.0°F							
Src Frz Setpt	30.0°F							
LD Frz Setpt	30.0°F							

Stat								
Status								
Unit Status	Auto							
Y1 Status	OFF							
Y2 Status	OFF							
O Status	OFF							
Emerg Shutdown	OFF							
Current Sens1	OFF							
Current Sens2	OFF							
Load Flow	OFF							
Src Flow	OFF							
Low Pres1	ON							
Hi Pres1	OFF							
Low Pres2	ON							
Hi Pres2	ON							
Comp1 Low Limit	NML							
Comp2 Low Limit	NML							


Outputs								
Outputs								
Comp1 Status	ON							
Comp2 Status	OFF							
Lead	Comp1							
Acc1 Status	OFF							
Stg1 Status	Normal							
Stg2 Status	Normal							
BO7	OFF							
BO8	OFF							
BO9	OFF							
EXPB01	OFF							
EXPB02	OFF							
EXPB07	OFF							
EXPB08	OFF							

Outnute

Settings
Settings
Unit of Measure F


Unit Display and Interface cont.

MUI Menu Navigation for NDW cont.

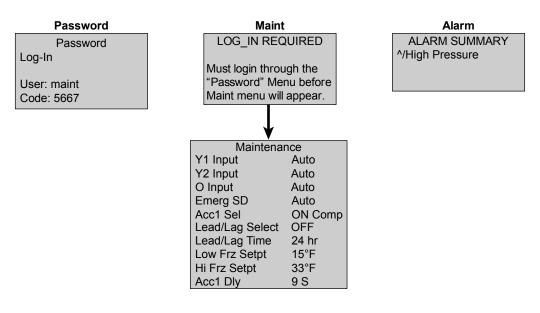

Alm-History

Alarm	#Events	
Load Flow	0	
Lo Press1	0	
Src Freeze1	0	
Ld Freeze1	0	
Src Flow	0	
Hi Press1	0	
Src FP1 Bad	0	_
Ld FP1 Bad	0	
Lo Press2	0	
Src Freeze2	0	
Src FP2 Bad	0	
Ld Freeze2	0	
Ld FP2 Bad	0	
Hi Press2	0	



NOTE: This FX10 application implements an **alarm history** which is reset only by cycling power. This history shows on the Alm-History page. Any alarm showing 2+ events has occurred more than 2 times.

Alarm lock-outs are reset by cycling power, by pressing the "ESC" and Return ← keys simultaneously for a minimum of 15 seconds, or by commanding the nviAlarmReset over the BAS network.

Test mode is enabled by holding the 'Esc' and Down Arrow simultaneously for a minimum of 15 seconds and releasing. Test mode times out after 30 minutes, and may also be ended by pressing 'ESC' and Up Arrow simultaneously and releasing. Test Mode bypasses the On Delay (90 sec) and Random Start timers for quicker troubleshooting. It also allows cycling the reversing valve without compressor shutdown.

Unit Display and Interface cont.

Menu and Menu Contents

Alarm

 Displays unit alarms until the unit has been reset (Unit alarms can be reset by holding both the Escape (ESC) key and Return (←) key for five seconds or by power cycling the unit.)

Alarm History

If a fault occurs the fault will be recorded in history viewable on the unit mounted display. Each fault type will be displayed in the history menu with a number between 0 and 3. A reading of 3+ means that the fault has occurred more than 3 times in the past. The history menu can be cleared with a power cycle only. Alarm date and time are not included in the history.

Unit Alarms

Unit alarms are shown on the display once the unit has locked out.

Load Flow - Load Flow Switch is Not Closed

 The load flow switch must be closed prior to either compressor starting and must remain closed for the entire run time of the compressor(s).

Low Pressure 1 - Compressor Circuit 1 Low Pressure Switch

 The low pressure switch is checked before compressor start up and is monitored during compressor operation.

Src FP 1 Temp Low - Source Freeze Detection Sensor 1

 The source freeze detection sensor on compressor circuit 1 has reached its setpoint.

Src FP 1 Sensor Bad

 The sensor for Source freeze detection on compressor circuit 1 is unreliable or is not reading.

LD FP 1 Temp Low - Load Freeze Detection Sensor 1

 The load freeze detection sensor on compressor circuit 1 has reached its setpoint.

LD FP 1 Sensor Bad

 The sensor for Load freeze detection on compressor circuit 1 is unreliable or is not reading.

Source Flow - Source Flow Switch is Not Closed

 The source flow switch must be closed prior to either compressor starting and must remain closed for the entire run-time of the compressor(s).

High Pressure 1 - Compressor Circuit 1 High Pressure Switch

 If high pressure switch 1 opens at any time during compressor 1 run time the compressor will be shut down immediately.

Low Pressure 2 - Compressor Circuit 2 Low Pressure Switch

 The low pressure switch is checked before compressor start up and is monitored during compressor operation.

Src FP 2 Temp Low - Source Freeze Detection Sensor 2

The source freeze detection sensor on compressor circuit
 2 has reached its setpoint.

Src FP 2 Sensor Bad

 The sensor for Source freeze detection on compressor circuit 2 is unreliable or is not reading.

LD FP 2 Temp Low - Load Freeze Detection Sensor 2

• The load freeze detection sensor on compressor circuit 2 has reached its setpoint.

LD FP 2 Sensor Bad

• The sensor for Load freeze detection on compressor circuit 2 is unreliable or is not reading.

High Pressure 2 - Compressor Circuit 2 High Pressure Switch

 If high pressure switch 2 opens at any time during compressor 2 run time the compressor will be shut down immediately.

Comp Start Failure - Compressor Start Failure

 If either compressor fails to start when the contactor pulls in the compressor current switch will cause that compressor to be locked out after 2 retries. The other compressor will continue to operate normally in this condition.

Physical Data

Model	NDW					
Model	100	120	150	180		
Compressor (2 each)		Sc	roll			
Factory Charge R410A, oz [kg]	62 [1.76]	62 [1.76]	62 [1.76]	62 [1.76]		
Load Water Connection						
FPT - in	2	2	2	2		
Source Water Connection						
FPT - in	2	2	2	2		
Weight - Operating, lb [kg]	390 [177]	400 [181]	400 [181]	420 [190]		
Weight - Packaged, lb [kg]	385 [175]	395 [179]	395 [179]	415 [188]		

3/9/09

Performance Standard (AHRI/ISO/ASHRAE 13256-2)

The performance standard AHRI/ASHRAE/ISO 13256-2 became effective January 1, 2000. This new standard has three major categories: Water Loop, Ground Water, and Ground Loop.

Unit of Measure: The Cooling COP

The cooling efficiency is measured in EER (US version measured in Btuh per Watt. The Metric version is measured in a cooling COP (Watt per Watt) similar to the traditional COP measurement.

Pump Power Correction Calculation

Within each model, only one water flow rate is specified for all three groups and pumping Watts are calculated using the following formula. This additional power is added onto the existing power consumption.

• Pump power correction = (gpm x 0.0631) x (Press Drop x 2990) / 300

Where 'gpm' is waterflow in gpm and 'Press Drop' is the pressure drop through the unit heat exchanger at rated water flow in feet of head.

ISO Capacity and Efficiency Calculations

The following equations illustrate cooling calculations:

- ISO Cooling Capacity = Cooling Capacity (Btuh) x 3.412
- ISO EER Efficiency (W/W) = ISO Cooling Capacity (Btuh) x 3.412 / [Power Input (Watts) + Pump Power Correction (Watt)] The following equations illustrate heating calculations:
- ISO Heating Capacity = Heating Capacity (Btuh) x 3.412
- ISO COP Efficiency (W/W) = ISO Heating Capacity (Btuh) x 3.412 / [Power Input (Watts) + Pump Power Correction (Watt)]

Test Conditions	ISO/ARI 13256-2 WLHP	ISO/ARI 13256-2 GWHP	ISO/ARI 13256-2 GLHP
Cooling			
Liquid Entering Indoor Side - °F	53.6	53.6	53.6
Standard Rating Test			
Liquid Entering Heat Exchanger - °F	86	59	77
Part-load Rating Test			
Liquid Entering Heat Exchanger	86	59	68
Fluid Flow Rate	*	*	*
Heating			
Liquid Entering Indoor Side - °F	104	104	104
Standard Rating Test			
Liquid Entering Outdoor-side Heat Exchanger - °F	68	50	32
Part-load Rating Test			
Liquid Entering Outdoor-side Heat Exchanger	68	50	41
Fluid Flow Rate	*	*	*

Conversions

Water Flow (lps) = GPM x 0.0631 Press Drop (Pascals) = Press Drop (ft hd) x 2990

NOTES: *Flow rate is specified by the manufacturer

WLHP = Water Loop Heat Pump; GWHP = Ground Water Heat Pump;

GLHP = Ground Loop Heat Pump

AHRI/ISO 13256-2 Performance Ratings

English (IP) Units

				W	ater Loop	Heat Pump		Gr	ound Wate	r Heat Pump		Gr	ound Loop	Heat Pump	
Model	Capacity Modulation	Flow	Rate	Cool EWT ELT 5	86°F	Heati EWT 6 ELT 10	8°F	Coo EWT ELT 5	59°F	Heatin EWT 50 ELT 104)°F	Cool Full ES Part ES ELT 5	T 77°F T68°F	Heatir Full EST Part EST ELT 104	32°F '41°F
		gpm	cfm	Capacity Btuh	EER Btuh/W	Capacity Btuh	СОР	Capacity Btuh	EER Btuh/W	Capacity Btuh	СОР	Capacity Btuh	EER Btuh/W	Capacity Btuh	СОР
100	Full	23	23	95,000	14.8	127,000	4.1	108,000	23.0	106,000	3.4	102,000	17.2	84,000	3.1
100	Part	23	23	52,000	16.3	68,000	4.7	59,000	25.5	56,000	3.8	57,000	22.5	49,000	3.5
100	Full	28	28	105,000	14.2	145,000	4.0	125,000	22.0	120,000	3.3	116,000	16.5	95,000	3.0
120	Part	28	28	60,000	15.8	78,000	4.5	67,000	24.0	64,000	3.8	65,000	21.5	56,000	3.4
150	Full	32	32	129,000	13.5	199,000	4.0	153,000	21.1	148,000	3.2	147,000	16.0	123,000	2.8
150	Part	32	32	72,000	15.3	101,000	4.3	75,000	22.0	73,000	3.7	78,000	20.7	70,000	3.3
100	Full	36	36	150,000	13.3	221,000	3.9	175,000	19.8	173,000	3.1	165,000	15.8	139,000	2.7
180	Part	36	36	78,000	15.0	113,000	4.2	89,000	20.9	87,000	3.7	86,000	18.4	82,000	3.5

NOTES: All ratings based upon 208V operation.

Rated in accordance with but not certified by AHRI.

AHRI does not currently certify water-to-water products under AHRI/ISO 13256-2.

EnergyStar does not currently recognize water-to-water products.

3/9/09

Reference Calculations

Heating Calculations: Cooling Calculations:
$$LWT = EWT - \frac{HE}{GPM \times 500^*}$$

$$LWT = EWT + \frac{HR}{GPM \times 500^*}$$

NOTE: * When using water. Use 485 for 15% methanol/water or Environol solution.

Legends and Notes

Abbreviations and Definitions

ELT = entering load fluid temperature to heat pump PSI = pressure drop in pounds per square inch LLT = leaving load fluid temperature from heat pump FT HD = pressure drop in feet of head LGPM = load flow in gallons per minute ΚW = kilowatt LWPD = load heat exchanger water pressure drop HR = heat rejected in MBTUH = entering source fluid temperature to heat pump TC = total cooling capacity in MBTUH = leaving source fluid temperature from heat pump COP = coefficient of performance (HC/KW x 3.413) SGPM = source flow in gallons per minute HC = heating capacity in MBTUH SWPD = source heat exchanger water pressure drop HE = heat of extraction in MBTUH EER = cooling energy effciency (TC/KW)

Notes to Capacity Data Tables

The following notes apply to all capacity data tables:

- Three flow rates are shown for each unit. The lowest flow rate shown is used for geothermal open loop/well water systems with a minimum of 50°F EST. The middle flow rate shown is the minimum geothermal closed loop flow rate. The highest flow rate shown is optimum for geothermal closed loop systems and the suggested flow rate for boiler/ tower applications.
- Entering water temperatures below 40°F assumes 15% antifreeze solution.
- Interpolation between ELT, EST, and GPM data is permissible.
- Operation in the gray areas is not recommended.

NDW100 - Performance Data

Cooling Capacity

Sou	irce			Load	Flow - 1	5 GPM			l .	Lo	oad Flov	v - 23 GF	M		l .	Lo	ad Flow	/ - 30 GP	M	
EST	Flow	ELT	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F
		50	35.6	108.0	3.80	121.0	28.4	44.5	41.3	111.7	3.91	125.1	28.6	45.0	43.1	115.0	4.00	128.6	28.8	47.2
	15	70 90	54.3 73.0	117.9 127.9	3.90 4.00	131.2 141.5	30.2 32.0	45.7 47.0	60.5 79.7	121.7	3.99 4.07	135.3 145.6	30.5 32.3	46.2 47.5	62.5 81.9	125.0 135.0	4.07 4.13	138.9 149.1	30.7 32.7	48.5 49.9
		110	91.6	137.8	4.10	151.8	33.6	48.2	98.9	141.6	4.07	155.8	34.1	48.7	101.3	145.0	4.13	159.3	34.5	51.2
		50	35.3	110.1	3.69	122.7	29.8	39.6	41.1	113.8	3.80	126.7	29.9	39.9	43.0	116.9	3.89	130.2	30.0	41.3
		70	54.0	120.3	3.76	133.1	32.0	40.4	60.3	124.1	3.86	137.3	32.2	40.7	62.3	127.5	3.94	141.0	32.3	42.3
30	23	90	72.6	130.4	3.83	143.5	34.1	41.2	79.5	134.5	3.92	147.9	34.4	41.6	81.7	138.1	3.99	151.7	34.6	43.2
İ		110	91.3	140.6	3.90	153.9	36.1	42.0	98.7	144.9	3.97	158.5	36.5	42.4	101.1	148.7	4.04	162.5	36.8	44.1
		50	35.1	112.0	3.60	124.3	31.1	37.5	41.0	115.5	3.71	128.2	31.2	37.7	42.9	118.6	3.80	131.6	31.2	38.8
	30	70	53.7	122.3	3.64	134.8	33.6	38.1	60.1	126.3	3.74	139.1	33.7	38.3	62.2	129.7	3.83	142.8	33.8	39.5
	30	90	72.3	132.7	3.68	145.2	36.1	38.7	79.3	137.0	3.78	149.9	36.3	39.0	81.5	140.9	3.87	154.1	36.4	40.3
		110	90.9	143.0	3.72	155.7	38.4	39.3	98.4	147.8	3.82	160.8	38.7	39.6	100.9	152.0	3.90	165.3	39.0	41.0
		50	36.6	100.3	5.23	118.1	19.2	64.2	41.9	103.7	5.33	121.9	19.5	64.6	43.6	106.7	5.41	125.2	19.7	66.7
	15	70	55.1	111.5	5.37	129.8	20.8	65.6	61.0	115.0	5.45	133.6	21.1	66.0	62.9	118.1	5.52	137.0	21.4	68.3
		90	73.6	122.7	5.51	141.4	22.3	67.0	80.1	126.3	5.57	145.3	22.7	67.4	82.2	129.6	5.63	148.8	23.0	69.8
		110 50	92.2 36.4	133.9 102.1	5.65 5.09	153.1 119.4	23.7	68.4 59.3	99.2 41.7	137.7 105.4	5.69 5.18	157.1 123.1	24.2	68.9 59.6	101.5 43.5	141.0 108.4	5.73 5.26	160.6 126.3	24.6 20.6	71.4 61.0
		70	54.9	113.5	5.19	131.2	21.9	60.3	60.8	117.2	5.27	135.1	22.2	60.6	62.8	120.4	5.34	138.6	22.6	62.0
50	23	90	73.3	124.9	5.28	142.9	23.6	61.2	79.9	128.9	5.35	147.1	24.1	61.5	82.1	132.3	5.41	150.8	24.5	63.1
		110	91.8	136.3	5.38	154.7	25.3	62.1	99.0	140.6	5.44	159.1	25.9	62.5	101.3	144.3	5.49	163.1	26.3	64.2
		50	36.2	103.6	4.98	120.6	20.8	57.2	41.6	106.9	5.06	124.2	21.2	57.5	43.4	109.9	5.13	127.3	21.4	58.5
İ	70	70	54.6	115.3	5.03	132.4	22.9	57.9	60.7	119.0	5.11	136.4	23.3	58.2	62.7	122.3	5.18	140.0	23.6	59.3
	30	90	73.1	126.9	5.09	144.2	25.0	58.7	79.7	131.1	5.16	148.7	25.4	58.9	81.9	134.8	5.23	152.6	25.8	60.2
		110	91.5	138.5	5.14	156.0	26.9	59.4	98.8	143.2	5.21	161.0	27.5	59.7	101.2	147.3	5.28	165.2	27.9	61.0
		50	37.7	92.5	6.65	115.2	13.9	83.8	42.5	95.6	6.74	118.7	14.2	84.2	44.1	98.4	6.83	121.7	14.4	86.2
	15	70	56.0	105.0	6.83	128.3	15.4	85.4	61.5	108.3	6.91	131.9	15.7	85.8	63.3	111.3	6.97	135.1	16.0	88.0
		90	74.3	117.4	7.02	141.4	16.7	87.0	80.5	121.0	7.07	145.1	17.1	87.4	82.6	124.1	7.12	148.4	17.4	89.8
		110	77.5	0.4.0	0.40		14.5	70.1	40.4	071	0.50	110.5	14.0	70.4	440	00.0	0.07	100.4	15.1	20.0
		50 70	37.5 55.8	94.0	6.49	116.1 129.2	14.5 16.1	79.1 80.1	42.4 61.4	97.1	6.56 6.67	119.5 132.9	14.8	79.4 80.4	44.0	99.8	6.63	122.4	15.1	80.6
70	23	90	74.1	119.4	6.61	142.4	17.7	80.1	80.4	123.2	6.79	146.4	16.5 18.2	80.4	63.2 82.4	126.6	6.73 6.83	136.2 149.9	16.8 18.5	81.8 83.0
		110	74.1	115.4	0.74	142.4	17.7	01.1	00.4	125.2	0.73	140.4	10.2	01.5	02.4	120.0	0.03	143.3	10.5	05.0
İ		50	37.3	95.3	6.35	116.9	15.0	77.0	42.3	98.4	6.40	120.2	15.4	77.2	43.9	101.1	6.45	123.1	15.7	78.2
İ		70	55.6	108.2	6.42	130.1	16.8	77.8	61.3	111.8	6.47	133.8	17.3	78.0	63.1	114.9	6.52	137.1	17.6	79.1
İ	30	90	73.9	121.1	6.49	143.2	18.7	78.6	80.2	125.1	6.54	147.5	19.1	78.8	82.3	128.7	6.58	151.2	19.5	80.1
		110																		
		50	38.7	84.8	8.08	112.3	10.5	103.5	43.1	87.6	8.16	115.5	10.7	103.9	44.6	90.1	8.24	118.2	10.9	105.8
	15	70	56.9	98.5	8.30	126.8	11.9	105.2	62.0	101.6	8.37	130.2	12.1	105.6	63.7	104.4	8.42	133.1	12.4	107.8
	15	90	75.0	112.2	8.53	141.3	13.2	107.0	80.9	115.7	8.57	144.9	13.5	107.4	82.9	118.7	8.61	148.1	13.8	109.7
		110				442.2												***		
		50	38.5	85.9	7.89	112.8	10.9	98.8	43.1	88.8	7.94	115.9	11.2	99.1	44.5	91.3	7.99	118.6	11.4	100.3
90	23	70	56.7 74.8	99.9	8.04	127.3	12.4	100.0	61.9	103.2	8.08	130.7	12.8	100.2	63.6	106.0	8.12	133.8	13.1	101.6
		90	/4.8	113.9	8.19	141.8	13.9	101.1	80.8	117.6	8.22	145.6	14.3	101.4	82.8	120.8	8.25	149.0	14.6	103.0
		50	38.4	86.9	7.73	113.2	11.2	96.8	43.0	89.8	7.75	116.2	11.6	97.0	44.5	92.4	7.78	118.9	11.9	97.9
		70	56.5	101.1	7.73	127.7	12.9	97.7	61.8	104.5	7.84	131.2	13.3	97.9	63.6	107.5	7.86	134.3	13.7	99.0
	30	90	74.6	115.3	7.90	142.2	14.6	98.5	80.7	119.2	7.92	146.2	15.1	98.8	82.6	122.6	7.94	149.7	15.4	100.0
		110																		
		50	39.7	77.0	9.50	109.4	8.1	123.1	43.8	79.6	9.58	112.2	8.3	123.5	45.1	81.8	9.65	114.7	8.5	125.3
	15	70	57.7	92.0	9.77	125.3	9.4	125.0	62.6	95.0	9.83	128.5	9.7	125.4	64.1	97.5	9.88	131.2	9.9	127.5
	15	90	75.7	107.0	10.03	141.2	10.7	126.9	81.4	110.3	10.07	144.7	11.0	127.4	83.2	113.3	10.10	147.7	11.2	129.7
		110																		
		50	39.6	77.8	9.29	109.5	8.4	118.6	43.7	80.4	9.32	112.3	8.6	118.8	45.0	82.8	9.36	114.7	8.8	120.0
110	23	70	57.6	93.1	9.46	125.4	9.8	119.8	62.5	96.2	9.49	128.6	10.1	120.1	64.1	98.9	9.52	131.4	10.4	121.4
		90	75.6	108.3	9.64	141.2	11.2	121.1	81.2	111.9	9.66	144.9	11.6	121.3	83.1	115.0	9.67	148.0	11.9	122.9
		110	70 F	70 E	9.10	100 F	0.6	116 6	47 G	01.2	0.10	112.7	0.0	116.7	4E 0	97.6	0.10	114.6	9.2	117.6
		50 70	39.5 57.5	78.5 94.0	9.10	109.5 125.4	8.6 10.2	116.6 117.5	43.6 62.4	97.2	9.10 9.20	112.3 128.6	8.9 10.6	116.7 117.7	45.0 64.0	83.6 100.1	9.10	114.6 131.5	9.2	117.6 118.8
	30	90	75.4	109.5	9.30	141.2	11.8	118.5	81.1	113.3	9.20	145.0	12.2	118.7	83.0	116.5	9.30	148.3	12.5	119.9
		110	, 5.4	100.0	3.30	171.2	11.0	110.0	51.1	115.5	3.30	1-3.0	14.4	110.7	55.0	110.0	5.50	140.0	12.0	113.3
		110																		1/7/00

NDW100 - Performance Data

Heating Capacity

Sou	irce			Load	Flow - 1	5 GPM				Lo	ad Flov	v - 23 GP	М			Lo	ad Flow	- 30 GP	M	
EWT	Flow	ELT	LLT	HC	Power	HE	СОР	LST	LLT	нс	Power	HE	СОР	LST	LLT	НС	Power	HE	СОР	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH	СОР	°F	°F	MBTUH	kW	MBTUH	COP	°F	°F	MBTUH	kW	MBTUH	СОР	°F
		60	71.1	83.0	5.00	65.9	4.9	11.2	67.4	85.6	4.89	68.9	5.1	14.0	65.9	87.8	4.80	71.4	5.4	15.2
20	30	80	90.8	80.9	6.67	58.2	3.6	12.2	87.2	83.2	6.49	61.1	3.8	14.7	85.7	85.2	6.33	63.6	3.9	15.8
20	30	100	110.5	78.9	8.33	50.4	2.8	13.3	107.0	80.9	8.08	53.3	2.9	15.4	105.5	82.6	7.87	55.8	3.1	16.3
		120	130.2	76.8	10.00	42.7	2.3	14.3	126.8	78.5	9.68	45.5	2.4	16.0	125.3	80.0	9.40	47.9	2.5	16.8
		60	72.2	91.3	5.01	74.2	5.3	20.1	68.2	94.5	4.85	78.0	5.7	23.2	66.5	97.3	4.71	81.2	6.1	24.6
	23	80	91.9	89.2	6.64	66.6	3.9	21.1	88.0	92.1	6.46	70.1	4.2	23.9	86.3	94.7	6.31	73.2	4.4	25.1
	23	100	111.6	87.2	8.28	58.9	3.1	22.1	107.8	89.8	8.08	62.2	3.3	24.6	106.1	92.1	7.91	65.1	3.4	25.7
30		120	131.3	85.1	9.91	51.3	2.5	23.2	127.6	87.4	9.70	54.3	2.6	25.3	126.0	89.5	9.51	57.0	2.8	26.2
30		60	72.3	92.0	5.10	74.6	5.3	20.1	68.4	96.3	4.94	79.4	5.7	23.1	66.7	100.0	4.80	83.6	6.1	24.4
	70	80	92.0	89.9	6.77	66.8	3.9	21.1	88.2	93.9	6.59	71.4	4.2	23.8	86.5	97.4	6.43	75.4	4.4	25.0
	30	100	111.7	87.9	8.43	59.1	3.1	22.1	108.0	91.6	8.24	63.5	3.3	24.5	106.3	94.8	8.07	67.3	3.4	25.5
		120	131.4	85.8	10.10	51.3	2.5	23.2	127.8	89.2	9.89	55.5	2.6	25.2	126.1	92.2	9.70	59.1	2.8	26.1
		60	73.6	102.2	5.00	85.1	6.0	38.7	69.2	105.4	4.84	88.9	6.4	42.3	67.2	108.3	4.70	92.3	6.8	43.8
	1.5	80	93.3	100.1	6.62	77.5	4.4	39.7	89.0	103.1	6.44	81.1	4.7	42.9	87.0	105.7	6.29	84.2	4.9	44.4
	15	100	113.1	98.1	8.20	94.3	26.0	37.4	108.8	100.7	4.72	84.6	6.3	42.6	106.9	103.1	7.88	76.2	3.8	44.9
		120	132.8	96.0	9.87	62.3	2.9	41.7	128.6	98.4	9.65	65.5	3.0	44.3	126.7	100.5	9.47	68.2	3.1	45.5
İ		60	74.4	107.7	5.12	90.2	6.2	38.0	69.7	111.9	4.95	95.0	6.6	41.7	67.7	115.5	4.81	99.1	7.0	43.4
		80	94.1	105.6	6.78	82.5	4.6	39.0	89.5	109.5	6.59	87.0	4.9	42.4	87.5	112.9	6.43	91.0	5.1	43.9
50	23	100	113.8	103.5	8.44	74.7	3.6	40.0	109.3	107.2	8.23	79.1	3.8	43.1	107.4	110.3	8.06	82.9	4.0	44.5
i		120	133.5	101.5	10.10	67.0	2.9	41.1	129.1	104.8	9.87	71.1	3.1	43.8	127.2	107.7	9.68	74.7	3.3	45.0
i		60	75.0	112.4	5.23	94.6	6.3	37.4	70.2	117.5	5.06	100.2	6.8	41.3	68.1	121.9	4.90	105.1	7.3	43.0
i		80	94.7	110.4	6.92	86.8	4.7	38.4	90.0	115.1	6.73	92.2	5.0	42.0	88.0	119.3	6.56	96.9	5.3	43.5
	30	100	114.4	108.3	8.61	78.9	3.7	39.5	109.8	112.8	8.40	84.1	3.9	42.7	107.8	116.7	8.21	88.7	4.2	44.1
		120	134.2	106.3	10.30	71.1	3.0	40.5	129.6	110.4	10.07	76.1	3.2	43.4	127.6	114.1	9.87	80.4	3.4	44.6
		60	75.2	113.9	5.10	96.5	6.5	57.1	70.3	118.4	4.94	101.6	7.0	61.2	68.2	122.4	4.80	106.0	7.5	62.9
i		80	94.9	111.8	6.74	88.8	4.9	58.2	90.1	116.1	6.57	93.7	5.2	61.9	88.0	119.8	6.41	97.9	5.5	63.5
i	15	100	114.6	109.8	8.39	81.1	3.8	59.2	109.9	113.7	8.19	85.8	4.1	62.5	107.8	117.2	8.02	89.8	4.3	64.0
İ		120	134.4	107.7	10.03	73.5	3.1	60.2	129.7	111.4	9.82	77.9	3.3	63.2	127.6	114.6	9.63	81.7	3.5	64.6
i		60	76.5	124.0	5.24	106.1	6.9	55.8	71.2	129.2	5.06	111.9	7.5	60.3	68.9	133.8	4.91	117.0	8.0	62.2
		80	96.3	122.0	6.92	98.3	5.2	56.9	91.0	126.9	6.73	103.9	5.5	61.0	88.7	131.2	6.55	108.8	5.9	62.7
70	23	100	116.0	119.9	8.60	90.6	4.1	57.9	110.8	124.5	8.39	95.9	4.4	61.7	108.6	128.6	8.20	100.6	4.6	63.3
l		120	135.7	117.8	10.28	82.8	3.4	59.0	130.6	122.2	10.05	87.9	3.6	62.4	128.4	126.0	9.85	92.4	3.7	63.8
		60	77.7	132.9	5.37	114.6	7.3	54.7	72.1	138.7	5.17	121.0	7.9	59.5	69.6	143.7	5.00	126.7	8.4	61.6
		80	97.4	130.8	7.08	106.7	5.4	55.8	91.9	136.3	6.86	112.9	5.8	60.2	89.4	141.1	6.68	118.3	6.2	62.1
	30	100	117.2	128.8	8.79	98.8	4.3	56.8	111.7	134.0	8.56	104.8	4.6	60.9	109.2	138.5	8.36	110.0	4.9	62.7
		120	136.9	126.7	10.50	90.9	3.5	57.9	131.4	131.6	10.25	96.7	3.8	61.6	129.1	135.9	10.03	101.7	4.0	63.2
		60	76.7	125.6	5.20	107.9	7.1	75.6	71.4	131.4	5.04	114.2	7.6	80.1	69.1	136.5	4.90	119.8	8.2	82.0
		80	96.5	123.5	6.87	100.1	5.3	76.7	91.2	129.1	6.69	106.2	5.7	80.8	88.9	133.9	6.53	111.6	6.0	82.6
İ	15	100																		
		120																		
		60	78.7	140.4	5.36	122.1	7.7	73.7	72.7	146.6	5.17	128.9	8.3	78.8	70.1	152.0	5.01	134.9	8.9	81.0
		80	98.4	138.3	7.06	114.2	5.7	74.8	92.5	144.2	6.86	120.9	6.2	79.5	90.0	149.4	6.68	126.6	6.6	81.6
90	23	100	118.2	136.3	8.76	106.4	4.6	75.8	112.3	141.9	8.54	112.8	4.9	80.2	109.8	146.8	8.34	118.3	5.2	82.1
		120																		
		60	80.4	153.3	5.50	134.6	8.2	72.1	73.9	159.9	5.29	141.8	8.9	77.7	71.0	165.6	5.10	148.2	9.5	80.1
		80	100.2	151.3	7.23	126.6	6.1	73.1	93.7	157.5	7.00	133.6	6.6	78.4	90.9	163.0	6.80	139.8	7.0	80.7
	30	100	119.9	149.2	8.97	118.7	4.9	74.2	113.5	155.2	8.72	125.4	5.2	79.1	110.7	160.4	8.50	131.4	5.5	81.2
		120			0.07	11017		7		.00.2	5.7.2	.20.7	- U.L	70		100.7	5.55		0.0	
		120																		1/7/00

NDW120 - Performance Data

Cooling Capacity

Sou	irce			Load	Flow - 1	B GPM				Lo	oad Flov	v - 28 GF	M			Lo	ad Flow	- 36 GP	M	
EST	Flow	ELT	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F
		50	35.8	128.0	5.26	145.9	24.3	47.5	41.5	132.6	5.30	150.7	25.0	48.1	43.2	136.3	5.34	154.5	25.5	50.6
	18	70	54.0	143.7	5.43	162.2	26.5	49.5	60.4	148.9	5.47	167.5	27.2	50.1	62.4	153.0	5.51	171.8	27.8	52.9
		90	72.3 90.6	159.3 175.0	5.60 5.77	178.4 194.7	28.5 30.3	51.4 53.4	79.4 98.3	165.1	5.64 5.81	184.4	29.2 31.2	52.1	81.5 100.7	169.7 186.4	5.68 5.85	189.1 206.4	29.9 31.9	55.2
		110 50	35.4	131.3	5.77	148.6	26.0	41.6	41.3	136.1	5.81	153.5	26.7	54.1 42.0	43.0	139.9	5.85	157.4	27.3	57.5 43.7
		70	53.6	147.6	5.18	165.2	28.5	42.9	60.2	152.9	5.22	170.7	29.3	43.4	62.1	157.1	5.13	175.1	29.9	45.2
30	28	90	71.8	163.8	5.31	181.9	30.9	44.2	79.1	169.7	5.35	188.0	31.7	44.7	81.3	174.4	5.38	192.8	32.4	46.8
		110	90.0	180.0	5.43	198.5	33.1	45.5	98.0	186.5	5.48	205.2	34.1	46.1	100.4	191.7	5.51	210.5	34.8	48.3
		50	35.1	134.0	4.89	150.7	27.4	39.0	41.1	138.8	4.93	155.7	28.2	39.3	42.9	142.7	4.96	159.6	28.8	40.6
		70	53.3	150.7	4.98	167.7	30.3	40.1	60.0	156.1	5.02	173.2	31.1	40.4	62.0	160.5	5.05	177.7	31.8	41.8
	36	90	71.4	167.3	5.07	184.6	33.0	41.1	78.9	173.4	5.11	190.8	33.9	41.4	81.1	178.2	5.15	195.8	34.6	43.1
		110	89.6	184.0	5.16	201.6	35.7	42.1	97.7	190.7	5.20	208.4	36.6	42.5	100.2	196.0	5.24	213.9	37.4	44.3
		50	36.7	119.8	6.79	142.9	17.6	67.1	42.0	124.1	6.84	147.4	18.1	67.7	43.6	127.5	6.89	151.0	18.5	70.1
	10	70	55.0	135.4	6.95	159.1	19.5	69.1	61.0	140.3	7.01	164.2	20.0	69.7	62.8	144.2	7.06	168.3	20.4	72.4
	18	90	73.2	151.1	7.12	175.4	21.2	71.0	79.9	156.5	7.18	181.0	21.8	71.7	82.0	160.9	7.23	185.6	22.3	74.7
		110	91.5	166.8	7.29	191.6	22.9	73.0	98.9	172.8	7.35	197.9	23.5	73.7	101.1	177.6	7.40	202.8	24.0	77.0
		50	36.2	123.8	6.51	146.0	19.0	61.4	41.8	128.3	6.56	150.7	19.5	61.8	43.4	131.8	6.61	154.4	20.0	63.4
50	28	70	54.4	140.1	6.64	162.8	21.1	62.7	60.7	145.2	6.70	168.0	21.7	63.2	62.5	149.2	6.74	172.2	22.1	65.0
~~	20	90	72.6	156.4	6.78	179.6	23.1	64.1	79.6	162.1	6.83	185.4	23.7	64.5	81.7	166.6	6.88	190.1	24.2	66.5
		110	90.8	172.8	6.91	196.3	25.0	65.4	98.5	179.0	6.97	202.8	25.7	65.9	100.8	184.0	7.01	207.9	26.2	68.1
		50	35.9	127.1	6.29	148.5	20.2	58.9	41.5	131.6	6.34	153.3	20.8	59.2	43.2	135.3	6.38	157.1	21.2	60.5
	36	70	54.0	143.9	6.40	165.7	22.5	59.9	60.4	149.1	6.45	171.1	23.1	60.3	62.3	153.2	6.49	175.4	23.6	61.7
		90	72.1	160.7	6.50	182.9	24.7	61.0	79.3	166.5	6.55	188.9	25.4	61.3	81.4	171.2	6.60	193.7	26.0	62.9
		110	90.3	177.6	6.60	200.1	26.9	62.0	98.2	184.0	6.66	206.7	27.6	62.4	100.5	189.1	6.70	212.0	28.2	64.1
		50	37.6	111.5	8.31	139.9	13.4	86.8	42.6	115.5	8.38	144.1	13.8	87.3	44.1	118.8	8.44	147.5	14.1	89.7
	18	70	55.9	127.2	8.48	156.1	15.0	88.7	61.5	131.8	8.55	160.9	15.4	89.3	63.2	135.4	8.61	164.8	15.7	92.0
		90	74.1	142.8	8.65	172.3	16.5	90.7	80.5	148.0	8.72	177.7	17.0	91.3	82.4	152.1	8.78	182.1	17.3	94.3
		110	771	11.0.7	7.07	147.5	14.6	01.0	42.3	120 5	0.07	1470	15.0	01.6	47.0	107.0	0.00	151.4	15.7	07.0
		50 70	37.1 55.3	116.3 132.7	7.97 8.11	143.5 160.4	14.6 16.4	81.2 82.5	61.2	120.5	8.03 8.17	147.9 165.4	15.0 16.8	81.6 82.9	43.8 62.9	123.8 141.3	8.09 8.23	151.4 169.4	15.3 17.2	83.2 84.7
70	28	90	73.4	149.1	8.25	177.2	18.1	83.9	80.1	154.5	8.32	182.9	18.6	84.3	82.1	158.8	8.37	187.3	19.0	86.3
		110	75.4	143.1	0.23	177.2	10.1	03.3	00.1	154.5	0.52	102.3	10.0	04.5	02.1	130.0	0.57	107.5	13.0	00.5
		50	36.7	120.1	7.70	146.4	15.6	78.8	42.0	124.4	7.76	150.9	16.0	79.1	43.6	127.9	7.81	154.5	16.4	80.3
		70	54.8	137.1	7.81	163.8	17.6	79.8	60.9	142.1	7.87	168.9	18.0	80.1	62.7	146.0	7.93	173.1	18.4	81.5
	36	90	72.9	154.1	7.93	181.2	19.4	80.9	79.7	159.7	7.99	187.0	20.0	81.2	81.8	164.1	8.05	191.6	20.4	82.8
		110																		
		50	38.5	103.3	9.84	136.8	10.5	106.4	43.1	107.0	9.92	140.8	10.8	106.9	44.5	110.0	9.98	144.0	11.0	109.2
	10	70	56.8	118.9	10.00	153.0	11.9	108.4	62.1	123.2	10.09	157.6	12.2	108.9	63.7	126.7	10.15	161.3	12.5	111.5
	18	90	75.0	134.6	10.17	169.3	13.2	110.3	81.0	139.4	10.25	174.4	13.6	110.9	82.8	143.3	10.32	178.5	13.9	113.8
		110																		
		50	37.9	108.8	9.43	140.9	11.5	101.0	42.8	112.7	9.50	145.1	11.9	101.4	44.2	115.8	9.56	148.5	12.1	102.9
90	28	70	56.1	125.3	9.57	157.9	13.1	102.4	61.7	129.8	9.65	162.7	13.4	102.7	63.3	133.4	9.71	166.5	13.7	104.5
		90	74.2	141.8	9.72	174.9	14.6	103.7	80.6	146.9	9.80	180.3	15.0	104.1	82.5	151.0	9.86	184.6	15.3	106.1
		110			0.75	14:5	10 :	05 =	46		0:-	145 -	10.5	00.5	4	10.7.7	0.55	156.5		10.7.1
		50	37.4	113.2	9.10	144.2	12.4	98.7	42.5	117.2	9.17	148.5	12.8	98.9	44.0	120.5	9.23	152.0	13.1	100.1
	36	70	55.5	130.3	9.23	161.8	14.1	99.7	61.3	135.0	9.30	166.8	14.5	100.0	63.1	138.8	9.36	170.7	14.8	101.4
		90	73.6	147.5	9.36	179.4	15.8	100.8	80.2	152.8	9.43	185.0	16.2	101.1	82.1	157.1	9.49	189.5	16.5	102.6
		110	70.4	95.0	11.76	177.0	0.4	1261	47.7	98.4	11 4E	177 E	9.6	126.5	44.0	101.2	11 5 7	140 E	8.8	120.7
		50 70	39.4 57.7	110.7	11.36	133.8 150.0	9.6	126.1 128.0	43.7 62.6	114.7	11.45 11.62	137.5 154.3	8.6 9.9	126.5	44.9 64.1	101.2	11.53 11.70	140.5 157.8	10.1	128.7 131.0
	18	90	76.0	126.3	11.69	166.2	10.8	129.9	81.6	130.9	11.79	171.1	11.1	130.5	83.3	134.5	11.87	175.0	11.3	133.3
		110	- 3.3					5.0		120.0	, 0				- 5.0	12		3.0		
		50	38.8	101.2	10.88	138.4	9.3	120.8	43.3	104.9	10.97	142.3	9.6	121.1	44.6	107.8	11.04	145.5	9.8	122.7
		70	56.9	117.8	11.04	155.5	10.7	122.2	62.2	122.1	11.13	160.0	11.0	122.5	63.7	125.5	11.20	163.7	11.2	124.2
110	28	90	75.1	134.4	11.19	172.6	12.0	123.5	81.0	139.3	11.28	177.8	12.3	123.9	82.8	143.1	11.36	181.9	12.6	125.8
İ		110																		
		50	38.2	106.2	10.50	142.0	10.1	118.5	42.9	110.0	10.58	146.1	10.4	118.8	44.3	113.1	10.65	149.4	10.6	120.0
	70	70	56.3	123.5	10.64	159.9	11.6	119.6	61.8	128.0	10.73	164.6	11.9	119.9	63.4	131.6	10.80	168.4	12.2	121.2
	36	90	74.3	140.9	10.79	177.7	13.1	120.7	80.6	146.0	10.87	183.1	13.4	121.0	82.5	150.0	10.94	187.4	13.7	122.5
		110																		
																				4/3/09

NDW120 - Performance Data

Heating Capacity

Sou	irce			Load	Flow - 1	В БРМ				Lo	ad Flov	v - 28 GP	M			Lo	oad Flov	/ - 36 GP	M	
EWT °F	Flow GPM	ELT °F	LLT °F	HC MBTUH	Power kW	HE MBTUH	СОР	LST °F	LLT °F	HC MBTUH	Power kW	HE MBTUH	СОР	LST °F	LLT °F	HC MBTUH	Power kW	HE MBTUH	СОР	LST °F
		60	70.6	95.2	5.20	77.5	5.4	11.4	66.9	96.9	5.26	79.0	5.4	14.4	65.5	98.3	5.30	80.2	5.4	15.5
20	76	80	90.3	92.5	7.00	68.6	3.9	12.4	86.7	94.2	7.07	70.1	3.9	15.0	85.3	95.5	7.13	71.2	3.9	16.0
20	36	100	110.0	89.9	8.80	59.8	3.0	13.4	106.5	91.5	8.89	61.1	3.0	15.6	105.2	92.8	8.97	62.2	3.0	16.5
		120	129.7	87.2	10.60	51.0	2.4	14.3	126.3	88.8	10.71	52.2	2.4	16.3	125.0	90.0	10.80	53.2	2.4	17.0
		60	71.0	98.9	5.36	80.6	5.4	21.0	67.3	102.4	5.44	83.8	5.5	24.0	65.8	105.2	5.51	86.4	5.6	25.2
	28	80	90.7	96.2	7.16	71.8	3.9	22.0	87.1	99.6	7.26	74.9	4.0	24.7	85.7	102.4	7.34	77.3	4.1	25.7
	28	100	110.4	93.6	8.96	63.0	3.1	23.0	106.9	96.9	9.08	65.9	3.1	25.3	105.5	99.6	9.18	68.3	3.2	26.2
30		120	130.1	90.9	10.76	54.2	2.5	24.0	126.7	94.2	10.90	57.0	2.5	25.9	125.4	96.9	11.01	59.3	2.6	26.7
30		60	71.2	101.2	5.40	82.8	5.5	20.8	67.6	106.1	5.51	87.3	5.6	23.8	66.1	110.0	5.60	90.9	5.8	25.0
	36	80	90.9	98.5	7.20	74.0	4.0	21.8	87.4	103.4	7.33	78.4	4.1	24.4	86.0	107.2	7.43	81.9	4.2	25.5
	30	100	110.7	95.9	9.00	65.2	3.1	22.8	107.2	100.6	9.15	69.4	3.2	25.0	105.8	104.5	9.27	72.8	3.3	26.0
		120	130.4	93.2	10.80	56.4	2.5	23.7	127.0	97.9	10.97	60.5	2.6	25.7	125.7	101.7	11.10	63.8	2.7	26.5
		60	72.6	113.4	5.53	94.5	6.0	39.5	68.4	116.9	5.59	97.8	6.1	43.0	66.7	119.7	5.63	100.5	6.2	44.4
	18	80	92.3	110.7	7.33	85.7	4.4	40.5	88.2	114.2	7.41	88.9	4.5	43.6	86.5	117.0	7.47	91.5	4.6	44.9
	10	100	112.0	108.0	9.13	76.9	3.5	41.5	108.0	111.5	9.23	80.0	3.5	44.3	106.3	114.2	9.30	82.5	3.6	45.4
		120	131.7	105.4	10.93	68.1	2.8	42.4	127.8	108.7	11.04	71.1	2.9	44.9	126.2	111.4	11.13	73.4	2.9	45.9
		60	73.3	119.7	5.63	100.5	6.2	38.8	68.9	124.5	5.70	105.1	6.4	42.5	67.1	128.4	5.76	108.7	6.5	44.0
50	28	80	93.0	117.1	7.43	91.7	4.6	39.8	88.7	121.8	7.52	96.1	4.7	43.1	87.0	125.6	7.60	99.7	4.8	44.5
"	20	100	112.7	114.4	9.23	82.9	3.6	40.8	108.5	119.1	9.34	87.2	3.7	43.8	106.8	122.8	9.43	90.7	3.8	45.0
		120	132.4	111.7	11.03	74.1	3.0	41.8	128.3	116.4	11.16	78.3	3.1	44.4	126.7	120.1	11.26	81.6	3.1	45.5
		60	73.9	124.8	5.70	105.4	6.4	38.3	69.3	130.6	5.79	110.9	6.6	42.1	67.5	135.3	5.87	115.2	6.8	43.6
	36	80	93.6	122.1	7.50	96.5	4.8	39.3	89.1	127.9	7.61	101.9	4.9	42.7	87.4	132.5	7.70	106.2	5.0	44.1
	00	100	113.3	119.5	9.30	87.7	3.8	40.3	108.9	125.2	9.43	93.0	3.9	43.4	107.2	129.7	9.53	97.2	4.0	44.6
		120	133.0	116.8	11.10	78.9	3.1	41.2	128.7	122.4	11.25	84.1	3.2	44.0	127.1	127.0	11.37	88.2	3.3	45.1
		60	74.5	130.7	5.77	111.1	6.6	57.7	69.7	136.1	5.82	116.2	6.9	61.7	67.8	140.4	5.87	120.3	7.0	63.3
	18	80	94.2	128.1	7.57	102.2	5.0	58.6	89.5	133.4	7.64	107.3	5.1	62.3	87.6	137.6	7.70	111.3	5.2	63.8
		100	113.9	125.4	9.37	93.4	3.9	59.6	109.3	130.6	9.46	98.4	4.0	63.0	107.5	134.8	9.53	102.3	4.1	64.3
		120	133.6	122.7	11.17	84.6	3.2	60.6	129.1	127.9	11.28	89.4	3.3	63.6	127.3	132.1	11.37	93.3	3.4	64.8
		60	75.6	140.5	5.90	120.4	7.0	56.6	70.5	146.7	5.96	126.3	7.2	61.0	68.4	151.6	6.01	131.0	7.4	62.7
70	28	80	95.3	137.9	7.70	111.6	5.3	57.6	90.3	143.9	7.78	117.4	5.4	61.6	88.3	148.8	7.85	122.0	5.6	63.2
		100	115.0	135.2	9.50	102.8	4.2	58.6	110.1	141.2	9.60	108.5	4.3	62.3	108.1	146.0	9.68	113.0	4.4	63.7
		120	134.7	132.5	11.30	94.0	3.4	59.6	129.9	138.5	11.42	99.5	3.6	62.9	128.0	143.3	11.51	104.0	3.6	64.2
		60	76.5	148.4	6.00	127.9	7.2	55.8	71.1	155.1	6.07	134.4	7.5	60.4	68.9	160.5	6.13	139.6	7.7	62.2
	36	80	96.2	145.7	7.80	119.1	5.5	56.8	90.9	152.4	7.89	125.5	5.7	61.0	88.8	157.8	7.97	130.6	5.8	62.7
		100	115.9	143.1	9.60	110.3	4.4	57.7	110.7	149.7	9.71	116.6	4.5	61.7	108.6	155.0	9.80	121.6	4.6	63.2
		120	135.6	140.4	11.40	101.5	3.6	58.7	130.5	147.0	11.53	107.6	3.7	62.3	128.5	152.2	11.63	112.5	3.8	63.7
		60	76.5	148.1	6.00	127.6	7.2	75.8	71.1	155.3	6.06	134.6	7.5	80.4	68.9	161.0	6.10	140.2	7.7	82.2
	18	80	96.2	145.4	7.80	118.8	5.5	76.8	90.9	152.5	7.87	125.7	5.7	81.0	88.8	158.2	7.93	131.2	5.8	82.7
		100																		
		120				4.16						4.15								
		60	77.9	161.4	6.17	140.3	7.7	74.4	72.1	168.8	6.22	147.6	8.0	79.5	69.7	174.8	6.27	153.4	8.2	81.5
90	28	80	97.6	158.7	7.97	131.5	5.8	75.4	91.9	166.1	8.04	138.7	6.1	80.1	89.6	172.0	8.10	144.4	6.2	82.0
		100	117.3	156.0	9.77	122.7	4.7	76.4	111.7	163.4	9.86	129.7	4.9	80.7	109.4	169.2	9.93	135.4	5.0	82.5
		120																		
		60	79.1	172.0	6.30	150.5	8.0	73.3	72.8	179.7	6.36	158.0	8.3	78.7	70.3	185.8	6.40	164.0	8.5	80.9
	36	80	98.8	169.3	8.10	141.7	6.1	74.3	92.6	176.9	8.17	149.1	6.3	79.4	90.2	183.0	8.23	154.9	6.5	81.4
		100	118.5	166.7	9.90	132.9	4.9	75.2	112.4	174.2	9.99	140.1	5.1	80.0	110.0	180.3	10.07	145.9	5.2	81.9
		120																		

NDW150 - Performance Data

Cooling Capacity

Sou	ırce			Load	Flow - 2	1 GPM				Lo	ad Flov	v - 32 GP	M			Lo	oad Flow	- 42 GP	M	
EST	Flow	ELT	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F
		50	33.1	177.0	5.60	196.1	31.6	46.8	39.8	181.2	5.66	200.5	32.0	47.2	42.1	185.0	5.72	204.5	32.3	49.5
	21	70	51.7	192.7	5.83	212.6	33.0	48.2	58.9	197.4	5.90	217.6	33.5	48.6	61.4	201.7	5.96	222.1	33.8	51.2
		90	70.2 88.7	208.3	6.07	229.0 245.5	34.3 35.6	49.6 51.0	78.0 97.1	213.6 229.9	6.14	234.6 251.6	34.8 36.0	50.1 51.6	80.6 99.9	218.5	6.21	239.6 257.2	35.2 36.5	52.8 54.5
		50	33.0	178.0	5.44	196.6	32.7	41.1	39.7	182.5	5.50	201.3	33.2	41.3	42.0	186.6	5.55	205.5	33.6	42.8
		70	51.5	194.1	5.61	213.2	34.6	42.0	58.8	199.1	5.67	218.4	35.1	42.3	61.3	203.6	5.73	223.2	35.6	43.9
30	32	90	70.0	210.1	5.77	229.8	36.4	42.9	77.9	215.6	5.84	235.5	36.9	43.2	80.5	220.7	5.90	240.8	37.4	45.1
		110	88.5	226.1	5.93	246.3	38.1	43.9	96.9	232.2	6.01	252.7	38.6	44.2	99.8	237.7	6.08	258.5	39.1	46.2
		50	33.0	179.0	5.30	197.1	33.8	38.4	39.7	183.7	5.35	202.0	34.3	38.7	41.9	188.0	5.40	206.4	34.8	39.8
	42	70	51.4	195.3	5.40	213.8	36.2	39.2	58.7	200.6	5.46	219.2	36.7	39.4	61.2	205.3	5.51	224.1	37.2	40.7
	42	90	69.8	211.7	5.50	230.4	38.5	39.9	77.8	217.4	5.57	236.4	39.1	40.1	80.5	222.7	5.63	241.9	39.6	41.5
		110	88.3	228.0	5.60	247.1	40.7	40.6	96.8	234.3	5.67	253.6	41.3	40.9	99.7	240.0	5.74	259.6	41.8	42.4
		50	34.7	160.9	7.88	187.8	20.4	72.5	40.7	164.8	7.96	192.0	20.7	73.0	42.8	168.4	8.04	195.8	20.9	76.1
	21	70	53.2	176.8	8.11	204.4	21.8	74.5	59.8	181.2	8.19	209.1	22.1	75.1	62.1	185.2	8.28	213.4	22.4	78.5
		90	71.7	192.6	8.33	221.0	23.1	76.5	78.9	197.6	8.42	226.3	23.5	77.2	81.3	202.1	8.51	231.1	23.7	80.8
		110	90.1	208.5	8.56	237.7	24.4	78.5	98.0	213.9	8.65	243.5	24.7	79.2	100.6	218.9	8.75	248.7	25.0	83.2
		50 70	34.6 53.0	161.9 178.4	7.63 7.80	187.9 205.1	21.2	64.7 66.0	40.7 59.7	166.0 183.1	7.71 7.89	192.3	21.5	65.0 66.4	42.7 62.0	169.7 187.3	7.78 7.97	196.3 214.5	21.8	67.1 68.7
50	32	90	71.4	195.0	7.97	222.2	24.5	67.4	78.7	200.2	8.07	227.8	24.8	67.8	81.2	205.0	8.16	232.8	25.3	70.2
		110	89.8	211.6	8.15	239.4	26.0	68.7	97.8	217.4	8.25	245.5	26.3	69.2	100.5	222.6	8.34	251.1	26.7	71.8
		50	34.5	162.8	7.41	188.0	22.0	61.3	40.6	167.0	7.48	192.6	22.3	61.6	42.7	171.0	7.55	196.7	22.6	63.1
		70	52.9	180.0	7.53	205.7	23.9	62.3	59.6	184.9	7.61	210.8	24.3	62.6	61.9	189.3	7.69	215.5	24.6	64.4
	42	90	71.2	197.2	7.65	223.3	25.8	63.4	78.6	202.7	7.75	229.1	26.2	63.7	81.1	207.6	7.84	234.4	26.5	65.6
		110	89.6	214.4	7.78	241.0	27.6	64.5	97.6	220.5	7.88	247.4	28.0	64.8	100.3	226.0	7.98	253.2	28.3	66.9
		50	36.2	144.8	10.16	179.5	14.3	91.5	41.7	148.4	10.26	183.4	14.5	92.0	43.5	151.7	10.36	187.0	14.6	94.9
	21	70	54.7	160.9	10.38	196.3	15.5	93.6	60.7	164.9	10.49	200.7	15.7	94.1	62.8	168.7	10.59	204.8	15.9	97.3
	21	90	73.2	176.9	10.59	213.0	16.7	95.6	79.8	181.5	10.71	218.0	16.9	96.2	82.0	185.6	10.81	222.5	17.2	99.7
		110																		
		50	36.1	145.7	9.82	179.2	14.8	84.0	41.6	149.4	9.92	183.3	15.1	84.3	43.4	152.9	10.01	187.0	15.3	86.3
70	32	70	54.5	162.8	10.00	196.9	16.3	85.4	60.6	167.1	10.11	201.6	16.5	85.8	62.7	171.1	10.21	205.9	16.7	87.9
		90	72.9	180.0	10.18	214.7	17.7	86.8	79.6	184.8	10.30	220.0	17.9	87.2	81.9	189.3	10.41	224.8	18.2	89.5
		110	70.0	146.5	0.51	170.0	15.4	00.7	41.5	150.4	0.61	107.0	15.0	01.0	47.4	157.0	0.70	107.0	15.0	00.5
		50	36.0 54.3	146.5	9.51	178.9	15.4 17.0	80.7	41.5	150.4	9.61	183.2	15.6	81.0	43.4	153.9 173.2	9.70	187.0	15.9 17.5	82.5 83.8
	42	70 90	72.6	164.6 182.7	9.66 9.80	197.6 216.2	18.6	81.9 83.0	60.5 79.4	169.1 187.9	9.77 9.93	202.5	17.3 18.9	82.1 83.3	62.6 81.7	192.6	9.87	206.9 226.8	19.2	85.8
		110	72.0	102.7	9.80	210.2	10.0	83.0	75.4	107.9	9.93	221.0	10.9	85.5	81.7	192.0	10.03	220.8	19.2	85.1
		50	37.7	128.7	12.44	171.1	10.3	110.5	42.6	132.0	12.57	174.9	10.5	111.0	44.2	135.1	12.68	178.3	10.7	113.8
		70	56.2	144.9	12.65	188.1	11.5	112.6	61.6	148.7	12.78	192.3	11.6	113.1	63.5	152.1	12.90	196.1	11.8	116.2
	21	90	74.6	161.2	12.86	205.1	12.5	114.6	80.7	165.4	12.99	209.7	12.7	115.2	82.7	169.2	13.12	214.0	12.9	118.5
		110																		
		50	37.7	129.5	12.01	170.5	10.8	103.3	42.5	132.9	12.13	174.3	11.0	103.6	44.2	136.0	12.25	177.8	11.1	105.5
90	32	70	56.0	147.2	12.20	188.8	12.1	104.8	61.5	151.2	12.33	193.2	12.3	105.1	63.4	154.8	12.46	197.3	12.4	107.2
"	32	90	74.3	164.9	12.38	207.1	13.3	106.2	80.5	169.4	12.53	212.2	13.5	106.6	82.6	173.6	12.67	216.8	13.7	108.9
		110																		
		50	37.6	130.3	11.62	169.9	11.2	100.2	42.5	133.7	11.74	173.8	11.4	100.4	44.1	136.9	11.85	177.3	11.5	101.8
	42	70	55.8	149.3	11.79	189.5	12.7	101.4	61.4	153.4	11.93	194.1	12.9	101.6	63.3	157.2	12.05	198.3	13.0	103.2
		90	74.0	168.3	11.96	209.1	14.1	102.5	80.3	173.1	12.11	214.4	14.3	102.9	82.4	177.5	12.26	219.3	14.5	104.6
		50	39.3	112.6	14.72	162.8	7.6	129.5	43.5	115.6	14.87	166.4	7.8	130.0	44.9	118.4	15.00	169.6	7.9	132.6
		70	57.7	129.0	14.72	179.9	8.6	131.6	62.5	132.5	15.07	183.9	8.8	132.1	64.2	135.6	15.21	187.5	8.9	135.0
	21	90	76.1	145.5	15.12	197.1	9.6	133.6	81.6	149.3	15.28	201.4	9.8	134.2	83.5	152.8	15.42	205.4	9.9	137.4
		110	- 2	1.5.5						1.5.5					23.0					
		50	39.2	113.3	14.20	161.8	8.0	122.7	43.5	116.4	14.34	165.3	8.1	122.9	44.9	119.1	14.48	168.5	8.2	124.7
	70	70	57.5	131.6	14.39	180.7	9.1	124.1	62.4	135.2	14.55	184.9	9.3	124.5	64.1	138.5	14.70	188.6	9.4	126.4
110	32	90	75.7	149.8	14.59	199.6	10.3	125.6	81.3	154.0	14.76	204.4	10.4	126.0	83.2	157.9	14.92	208.8	10.6	128.2
		110																		
		50	39.1	114.0	13.72	160.8	8.3	119.6	43.4	117.0	13.87	164.4	8.4	119.9	44.9	119.8	14.00	167.6	8.6	121.2
	42	70	57.2	133.9	13.91	181.4	9.6	120.9	62.3	137.7	14.08	185.7	9.8	121.1	64.0	141.1	14.23	189.7	9.9	122.6
	74	90	75.4	153.8	14.11	201.9	10.9	122.1	81.1	158.3	14.30	207.1	11.1	122.4	83.0	162.5	14.47	211.8	11.2	124.1
		110																		4/3/09

NDW150 - Performance Data

Heating Capacity

Sou	ırce			Load	Flow - 2	1 GPM				Lo	oad Flov	v - 32 GP	M			Lo	oad Flov	v - 42 GP	М	
EWT	Flow	ELT	LLT	НС	Power	HE	СОР	LST	LLT	нс	Power	HE	СОР	LST	LLT	НС	Power	HE	СОР	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F
		60	70.6	110.8	7.30	85.9	4.4	11.8	67.2	114.8	7.09	90.6	4.7	14.3	65.6	118.4	6.90	94.9	5.0	15.5
20	42	80	90.1	106.2	9.57	73.6	3.3	13.0	86.9	110.8	9.34	78.9	3.5	15.1	85.5	114.9	9.13	83.8	3.7	16.0
	'-	100	109.7	101.6	11.83	61.2	2.5	14.2	106.7	106.8	11.59	67.2	2.7	15.8	105.3	111.5	11.37	72.7	2.9	16.5
		120	129.2	97.0	14.10	48.9	2.0	15.3	126.4	102.8	13.84	55.5	2.2	16.5	125.1	108.0	13.60	61.6	2.3	17.1
		60	71.5	120.3	6.45	98.3	5.5	20.6	67.7	123.6	6.79	100.5	5.3	23.7	66.0	126.6	7.10	102.4	5.2	25.1
	32	80	91.0	116.0	8.50	87.0	4.0	21.7	87.5	119.7	8.93	89.2	3.9	24.4	85.9	123.2	9.33	91.3	3.9	25.7
		100	110.6	111.6	10.54	75.6	3.1	22.8	107.2	115.8	11.08	78.0	3.1	25.1	105.7	119.7	11.57	80.2	3.0	26.2
30		120	130.2	107.2	12.59	64.3	2.5	23.9	127.0	111.9	13.22	66.8	2.5	25.8	125.5	116.2	13.80	69.1	2.5	26.7
		60	71.7	123.0	7.50	97.4	4.8	20.7	67.9	126.1	7.29	101.3	5.1	23.7	66.1	129.0	7.10	104.8	5.3	25.0
	42	80	91.3	118.6	9.77	85.3	3.6	21.9	87.6	122.2	9.54	89.7	3.8	24.4	86.0	125.5	9.33	93.7	3.9	25.5
		100	110.9	114.3	12.03	73.2	2.8	23.0	107.4	118.4	11.79	78.1	2.9	25.1	105.8	122.1	11.57	82.6	3.1	26.1
		120	130.5	109.9	14.30	61.1	2.3	24.2	127.2	114.5	14.04	66.6	2.4	25.8	125.6	118.6	13.80	71.5	2.5	26.6
		60	74.4	151.3	6.43	129.3	6.9	37.7	69.7	155.9	6.90	132.3	6.6	41.7	67.6	160.1	7.33	135.1	6.4	43.6
	21	80	94.0	146.9	8.38	118.3	5.1	38.7	89.5	152.0	8.99	121.3	5.0	42.4	87.5	156.6	9.56	124.0	4.8	44.1
		100	113.6	142.5	10.32	107.3	4.0	39.8	109.3	148.1	11.08	110.3	3.9	43.1	107.3	153.2	11.78	113.0	3.8	44.6
		120	133.2	138.2	12.27	96.3	3.3	40.8	129.0	144.2	13.17	99.3	3.2	43.8	127.1	149.7	14.00	101.9	3.1	45.1
ŀ		60	74.6	153.8	7.22	129.1	6.2	37.7	69.9	158.3	7.29	133.4	6.4	41.7	67.7	162.3	7.35	137.2	6.5	43.5
50	32	80	94.2	149.4	9.33	117.6	4.7	38.8	89.6	154.4	9.46	122.1	4.8	42.4	87.6	158.9	9.58	126.2	4.9	44.0
		100	113.8	145.0	11.45	106.0	3.7	39.9	109.4	150.5	11.63	110.8	3.8	43.1	107.4	155.4	11.81	115.1	3.9	44.5
ŀ		120	133.4	140.7	13.56	94.4	3.0	41.0	129.2	146.6	13.81	99.5	3.1	43.8	127.2	151.9	14.03	104.0	3.2	45.0
		60	74.9	156.1	7.93	129.0	5.8	37.7	70.0	160.4	7.64	134.3	6.2	41.6	67.8	164.3	7.37	139.2	6.5	43.4
	42	80	94.4	151.7	10.20	116.9	4.4	38.9	89.8	156.5	9.89	122.8	4.6	42.3	87.7	160.9	9.60	128.1	4.9	43.9
		100	114.0	147.3	12.47	104.8	3.5	40.0	109.5	152.6	12.13	111.2	3.7	43.0	107.5	157.4	11.83	117.0	3.9	44.4
		120	133.6	143.0	14.73	92.7	2.8	41.2	129.3	148.7	14.38	99.6	3.0	43.8	127.3	153.9	14.07	105.9	3.2	45.0
		60	77.6 97.2	185.1	7.57	159.3	7.2	54.8	71.9	190.9	7.57	165.1	7.4	59.7	69.3 89.2	196.2	7.57	170.4	7.6	61.9
	21	80		180.8	9.66	147.8	5.5	55.9	91.7	187.0	9.72	153.9	5.6	60.4		192.7	9.78	159.4	5.8	62.4
		100	116.8	176.4	11.74	136.3	3.6	57.0	111.4	183.1	11.87 14.03	142.6 131.4	4.5 3.7	61.1 61.8	109.0	189.3	11.99	148.4	4.6	62.9
		120	136.4 77.8	172.0	13.83 7.99	124.8 160.0	6.9	58.1	131.2 72.1	179.2	7.78	 	7.3	59.6	128.8	185.8 198.0	14.20	137.3	3.8 7.6	63.5
		60 80	97.4	187.2 182.9	10.17	148.2	5.3	54.8 55.9	91.8	192.9 189.0	9.99	166.3 154.9	7.5 5.5	60.3	69.4 89.3	194.5	7.60 9.82	172.1 161.0	5.8	61.8 62.3
70	32	100	117.0	178.5	12.35	136.4	4.2	57.0	111.6	185.1	12.19	143.5	4.4	61.0	109.1	191.1	12.05	150.0	4.6	62.9
		120	136.6	174.1	14.53	124.5	3.5	58.1	131.3	181.2	14.39	132.1	3.7	61.7	128.9	187.6	14.27	138.9	3.9	63.4
		60	78.0	189.1	8.37	160.6	6.6	54.7	72.2	194.7	7.98	167.4	7.1	59.5	69.5	199.7	7.63	173.6	7.7	61.7
		80	97.6	184.8	10.63	148.5	5.1	55.9	91.9	190.8	10.23	155.8	5.5	60.3	89.3	196.2	9.87	162.5	5.8	62.3
	42	100	117.2	180.4	12.90	136.4	4.1	57.0	111.7	186.9	12.48	144.3	4.4	61.0	109.2	192.7	12.10	151.4	4.7	62.8
		120	136.8	176.0	15.17	124.3	3.4	58.2	131.4	183.0	14.73	132.7	3.6	61.7	129.0	189.3	14.33	140.4	3.9	63.3
		60	80.9	219.0	8.70	189.3	7.4	72.0	74.1	226.0	8.23	197.9	8.0	77.6	71.1	232.3	7.80	205.7	8.7	80.2
1		80	100.4	214.6	10.93	177.3	5.8	73.1	93.9	222.1	10.44	186.4	6.2	78.3	90.9	228.8	10.00	194.7	6.7	80.7
i	21	100	100.4	214.0	10.55	177.5	3.0	75.1	33.3	222.1	10.44	100.4	0.2	70.5	30.3	220.0	10.00	134.7	0.7	00.7
i		120																		
		60	81.0	220.7	8.75	190.8	7.4	71.8	74.2	227.5	8.28	199.3	8.1	77.5	71.1	233.7	7.85	206.9	8.7	80.1
		80	100.6	216.3	11.00	178.8	5.8	73.0	94.0	223.6	10.51	187.7	6.2	78.3	91.0	230.2	10.07	195.9	6.7	80.7
90	32	100	120.2	211.9	13.25	166.7	4.7	74.1	113.7	219.7	12.75	176.2	5.1	79.0	110.8	226.8	12.29	184.9	5.4	81.2
		120					-													
		60	81.2	222.2	8.80	192.2	7.4	71.7	74.3	228.9	8.33	200.5	8.1	77.5	71.2	235.0	7.90	208.0	8.7	80.1
		80	100.7	217.8	11.07	180.1	5.8	72.9	94.1	225.0	10.58	188.9	6.2	78.2	91.0	231.5	10.13	197.0	6.7	80.6
İ	42	100	120.3	213.5	13.33	168.0	4.7	74.0	113.8	221.1	12.83	177.3	5.1	78.9	110.9	228.1	12.37	185.9	5.4	81.1
l		120																		
																				1/3/09

NDW180 - Performance Data

Cooling Capacity

Sou	ırce	Ĭ		Load	Flow - 2	4 GPM				Lo	ad Flov	v - 36 GF	PM			L	oad Flow	- 48 GP	M	
EST	Flow	ELT	LLT	TC	Power	HR	EER	LST	LLT	TC	Power	HR	EER	LST	LLT	тс	Power	HR	EER	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F	°F	MBTUH	kW	MBTUH		°F
		50 70	33.6	197.0	6.50	219.2	30.3	46.4 47.7	39.9 59.1	203.0	6.57	225.4	30.9	46.9 48.2	42.2 61.6	209.0	6.63	231.6	31.5	49.3
	24	90	52.3 71.0	212.7	6.73	235.6 252.1	31.6 32.8	47.7	78.3	219.0	6.81 7.06	242.2 259.1	32.1 33.3	49.4	80.9	225.3	6.89 7.15	248.8 266.1	32.7 33.8	50.7 52.2
		110	89.7	244.0	7.20	268.6	33.9	50.1	97.5	251.0	7.31	275.9	34.3	50.7	100.3	258.0	7.42	283.3	34.8	53.6
		50	33.5	198.5	6.35	220.2	31.3	41.0	39.8	204.5	6.43	226.4	31.8	41.3	42.1	210.5	6.52	232.7	32.3	42.9
		70	52.1	214.3	6.57	236.7	32.6	41.8	60.0	199.1	6.66	221.8	29.9	41.1	63.1	183.8	6.75	206.8	27.2	41.5
30	36	90	70.8	230.2	6.79	253.3	33.9	42.7	80.3	193.6	6.88	217.1	28.1	40.9	84.1	157.0	6.98	180.9	22.5	40.0
		110	89.5	246.0	7.01	269.9	35.1	43.5	100.6	188.2	7.11	212.4	26.5	40.6	105.1	130.3	7.21	154.9	18.1	38.6
		50	33.3	200.0	6.20	221.2	32.3	38.3	39.7	206.0	6.30	227.5	32.7	38.5	42.1	212.0	6.40	233.8	33.1	39.7
	48	70	52.0	216.0	6.40	237.8	33.7	38.9	61.0	179.1	6.50	201.3	27.5	37.5	64.7	142.2	6.60	164.7	21.5	36.9
	=0	90	70.7	232.0	6.61	254.5	35.1	39.5	82.4	152.2	6.70	175.1	22.7	36.6	87.3	72.4	6.80	95.6	10.7	34.0
		110	89.3	248.0	6.81	271.2	36.4	40.2	103.7	125.3	6.91	148.9	18.1	35.6	109.9	2.6	7.00	26.5	0.4	31.1
		50	34.9	180.8	8.86	211.0	20.4	65.8	40.7	186.3	8.96	216.8	20.8	66.3	42.8	191.8	9.05	222.6	21.2	68.6
	24	70	53.6	196.7	9.17	227.9	21.5	67.1	59.9	202.5	9.27	234.2	21.8	67.6	62.2	208.4	9.38	240.4	22.2	70.0
		90	72.3	212.6	9.47	244.9	22.4	68.4	79.1	218.8	9.59	251.6	22.8	68.9	81.6	225.1	9.71	258.2	23.2	71.5
		110	91.0 34.8	228.5	9.78	261.9	23.4	69.6	98.2	235.1	9.91	268.9	23.7	70.2	100.9	241.8	10.05	276.0	24.1	73.0
		50 70	53.4	182.4 199.4	8.62 8.91	211.8 229.8	21.2	60.6 61.5	40.6 60.5	188.0	8.73 9.02	217.7	21.5	60.9	42.7 63.3	193.5 178.8	9.14	223.7 210.0	21.9 19.6	62.4 61.7
50	36	90	72.0	216.4	9.20	247.8	23.5	62.4	80.5	190.3	9.32	222.1	20.4	61.1	83.8	164.1	9.45	196.3	17.4	60.9
		110	90.5	233.5	9.48	265.8	24.6	63.3	100.4	191.4	9.62	224.2	19.9	61.2	104.4	149.4	9.75	182.6	15.3	60.1
		50	34.7	184.0	8.38	212.6	22.0	58.0	40.5	189.7	8.50	218.7	22.3	58.2	42.7	195.3	8.63	224.8	22.6	59.4
		70	53.2	202.1	8.65	231.6	23.4	58.7	61.2	175.7	8.78	205.6	20.0	57.7	64.4	149.2	8.90	179.6	16.8	57.5
	48	90	71.6	220.3	8.92	250.7	24.7	59.4	81.9	161.7	9.05	192.6	17.9	57.2	86.1	103.1	9.18	134.4	11.2	55.6
		110	90.1	238.4	9.19	269.8	25.9	60.1	102.6	147.7	9.32	179.5	15.8	56.7	107.9	57.0	9.45	89.2	6.0	53.7
		50	36.3	164.5	11.23	202.8	14.6	85.2	41.5	169.5	11.35	208.2	14.9	85.6	43.5	174.5	11.47	213.6	15.2	87.8
	24	70	54.9	180.7	11.60	220.3	15.6	86.5	60.7	186.1	11.74	226.1	15.9	87.0	62.8	191.5	11.87	232.0	16.1	89.3
	24	90	73.6	196.8	11.98	237.7	16.4	87.8	79.9	202.7	12.12	244.0	16.7	88.3	82.2	208.5	12.27	250.4	17.0	90.9
		110																		
		50	36.1	166.3	10.89	203.4	15.3	80.2	41.4	171.4	11.03	209.0	15.5	80.5	43.4	176.6	11.16	214.7	15.8	81.9
70	36	70	54.6	184.5	11.25	222.8	16.4	81.1	61.0	179.2	11.39	218.0	15.7	80.9	63.5	173.8	11.54	213.2	15.1	81.8
		90	73.1	202.7	11.60	242.3	17.5	82.1	80.7	186.9	11.76	227.0	15.9	81.4	83.6	171.1	11.91	211.8	14.4	81.8
		110	70.0	100.0	10.55	2040	15.0	77.0	41.7	177.7	10.71	200.0	10.0	77.9	47.7	170.0	10.00	215.7	10.4	79.0
		50 70	36.0 54.3	168.0 188.3	10.55	204.0	15.9 17.3	77.6 78.5	41.3 61.4	173.3 172.2	10.71	209.8	16.2 15.6	77.9	43.3 64.1	178.6 156.2	10.86	215.7 194.4	16.4 13.9	79.0
	48	90	72.6	208.5	11.23	246.9	18.6	79.3	81.4	171.2	11.39	210.0	15.0	77.9	85.0	133.8	11.55	173.2	11.6	77.2
		110	72.0	200.5	11.25	240.3	10.0	73.3	01.4	17 1.2	11.55	210.0	15.0	77.5	03.0	133.0	11.55	175.2	11.0	77.2
		50	37.6	148.3	13.59	194.6	10.9	104.6	42.4	152.8	13.74	199.6	11.1	105.0	44.1	157.3	13.88	204.6	11.3	107.1
		70	56.3	164.7	14.04	212.6	11.7	105.9	61.5	169.6	14.20	218.1	11.9	106.4	63.5	174.6	14.36	223.6	12.2	108.6
	24	90	74.9	181.1	14.48	230.5	12.5	107.3	80.7	186.5	14.66	236.5	12.7	107.7	82.8	191.9	14.83	242.5	12.9	110.2
	İ	110																		
		50	37.5	150.1	13.16	195.0	11.4	99.8	42.3	154.9	13.32	200.3	11.6	100.0	44.0	159.6	13.49	205.6	11.8	101.4
90	36	70	55.9	169.5	13.59	215.9	12.5	100.8	61.5	169.2	13.76	216.2	12.3	100.8	63.7	168.9	13.94	216.4	12.1	102.0
30	30	90	74.3	189.0	14.01	236.8	13.5	101.8	80.8	183.6	14.20	232.0	12.9	101.6	83.3	178.2	14.38	227.2	12.4	102.6
		110																		
		50	37.3	152.0	12.73	195.4	11.9	97.3	42.2	157.0	12.91	201.0	12.2	97.5	43.9	161.9	13.09	206.6	12.4	98.6
	48	70	55.5	174.4	13.13	219.2	13.3	98.2	61.6	168.8	13.32	214.3	12.7	98.0	63.9	163.2	13.51	209.3	12.1	98.7
		90	73.6	196.8	13.54	243.0	14.5	99.1	81.0	180.6	13.74	227.5	13.1	98.5	83.8	164.4	13.93	211.9	11.8	98.8
		110	70.0	170.0	15.00	100.4	0.7	10.4.0	47.0	176.0	10.17	101.0	0.4	10.4.7	440	140.0	10.70	105.6	0.6	100.7
		50 70	39.0 57.6	132.0	15.96	186.4	8.3	124.0	43.2	136.0	16.13	191.0	8.4	124.3	44.8 64.1	140.0	16.30	195.6	8.6	126.3
	24	70 90	57.6 76.2	148.7 165.3	16.47 16.99	204.9	9.0	125.4 126.7	62.3 81.5	153.2 170.3	16.66 17.19	210.0	9.2	125.8 127.2	64.1 83.4	157.7 175.3	16.85 17.39	215.1 234.7	9.4	127.9 129.6
		110	/0.2	105.3	10.99	223.3	5./	120./	01.5	1/0.3	17.19	229.0	9.9	12/.2	03.4	1/3.3	17.59	234./	10.1	129.0
		50	38.8	134.0	15.43	186.6	8.7	119.3	43.1	138.3	15.62	191.6	8.9	119.6	44.7	142.6	15.81	196.6	9.0	120.9
		70	57.1	154.6	15.93	208.9	9.7	120.4	62.0	159.3	16.13	214.3	9.9	120.7	63.9	163.9	16.33	219.6	10.0	122.2
110	36	90	75.4	175.2	16.42	231.2	10.7	121.6	81.0	180.2	16.64	237.0	10.8	121.8	83.1	185.2	16.85	242.7	11.0	123.5
		110																		
		50	38.7	136.0	14.90	186.8	9.1	117.0	43.0	140.6	15.11	192.2	9.3	117.2	44.6	145.2	15.32	197.5	9.5	118.2
	1 40	70	56.6	160.5	15.38	213.0	10.4	118.0	61.7	165.4	15.60	218.6	10.6	118.2	63.6	170.2	15.82	224.1	10.8	119.3
	48	90	74.6	185.1	15.86	239.2	11.7	119.0	80.5	190.1	16.08	245.0	11.8	119.2	82.7	195.1	16.31	250.7	12.0	120.4
		110																		
	-	•																		4/3/09

NDW180 - Performance Data

Heating Capacity

Sou	rce			Load	Flow - 2	4 GPM				Lo	ad Flov	v - 36 GP	M			Lo	ad Flow	v - 48 GP	М	
EWT	Flow	ELT	LLT	HC	Power	HE	СОР	LST	LLT	HC	Power	HE	СОР	LST	LLT	HC	Power	HE	СОР	LST
°F	GPM	°F	°F	MBTUH	kW	MBTUH	COP	°F	°F	MBTUH	kW	MBTUH	COP	°F	°F	MBTUH	kW	MBTUH	COP	°F
		60	71.8	141.0	9.8	107.6	4.2	11.0	68.1	145.5	9.9	111.7	4.3	13.8	66.3	150.0	10.0	115.9	4.4	15.2
20	48	80	91.2	134.3	12.9	90.4	3.1	12.5	87.7	138.4	13.0	94.1	3.1	14.8	85.9	142.5	13.1	97.7	3.2	15.9
-		100	110.6	127.7	15.9	73.3	2.3	13.9	107.3	131.4	16.1	76.4	2.4	15.8	105.6	135.1	16.3	79.6	2.4	16.7
		120	130.1	121.0	19.0	56.2	1.9	15.3	126.9	124.3	19.2	58.8	1.9	16.7	125.3	127.6	19.4	61.4	1.9	17.4
		60	72.2	146.0	9.2	114.6	4.7	20.4	68.3	150.1	9.3	118.3	4.7	23.4	66.4	154.1	9.4	121.9	4.8	24.9
	36	80	91.8	141.0	12.1	99.9	3.4	21.7	88.0	144.9	12.3	103.1	3.5	24.3	86.2	148.8	12.4	106.3	3.5	25.6
		100	111.3	136.0	14.9	85.1	2.7	22.9	107.8	139.7	15.2	87.9	2.7	25.1	106.0	143.4	15.4	90.7	2.7	26.2
30		120	130.9	131.0	17.8	70.3	2.2	24.1	127.5	134.5	18.1	72.7	2.2	26.0	125.8	138.1	18.5	75.1	2.2	26.9
		60	72.5	150.0	10.1	115.5	4.4	20.4	68.6	154.1	10.3	119.1	4.4	23.4	66.6	158.3	10.4	122.7	4.5	24.9
	48	80	92.1	145.0	13.2	100.0	3.2	21.7	88.3	149.1	13.4	103.4	3.3	24.3	86.4	153.2	13.6	106.9	3.3	25.5
		100	111.7	140.0	16.3	84.4	2.5	23.0	108.0	144.1	16.5	87.7	2.6	25.1	106.2	148.2	16.7	91.0	2.6	26.2
		120	131.3	135.0	19.4	68.8	2.0	24.3	127.7	139.1	19.7	72.0	2.1	26.0	126.0	143.1	19.9	75.2	2.1	26.9
		60	74.9	178.7	8.8	148.8	6.0	37.6	70.2	184.0	8.9	153.7	6.1	41.5	67.9	189.3	9.0	158.6	6.2	43.4
	24	80	94.4	172.4	11.5	133.1	4.4	38.9	89.9	177.5	11.7	137.5	4.4	42.4	87.6	182.6	11.9	141.9	4.5	44.1
		100	113.9	166.2	14.3	117.5	3.4	40.2	109.5	171.0	14.6	121.3	3.4	43.3	107.3	175.8	14.8	125.2	3.5	44.8
		120	133.3	160.0	17.0	101.9	2.8	41.5	129.1	164.5	17.4	105.2	2.8	44.2	127.0	169.0	17.7	108.5	2.8	45.5
		60	75.3	183.8	9.7	150.7	5.5	37.4	70.5	189.3	9.9	155.6	5.6	41.4	68.1	194.8	10.0	160.6	5.7	43.3
50	36	80	94.8	177.6	12.7	134.1	4.1	38.8	90.2	182.8	12.7	139.5	4.2	42.2	87.8	188.1	12.6	145.0	4.4	44.0
		100	114.3	171.3	15.8	117.5	3.2	40.2	109.8	176.4	15.5	123.4	3.3	43.1	107.6	181.5	15.3	129.3	3.5	44.6
		120	133.8	165.1	18.8	101.0	2.6	41.6	129.4	170.0	18.4	107.3	2.7	44.0	127.3	174.9	17.9	113.7	2.9	45.3
		60	75.8	189.0	10.7	152.6	5.2	37.3	70.8	194.6	10.8	157.6	5.3	41.2	68.3	200.2	11.0	162.7	5.3	43.2
	48	80	95.2	182.7	14.0	135.1	3.8	38.7	90.5	188.2	13.7	141.6	4.0	42.1	88.1	193.7	13.4	148.1	4.2	43.8
		100 120	114.7 134.2	176.4 170.1	17.2 20.5	117.6 100.1	3.0 2.4	40.2 41.7	110.1 129.7	181.8 175.4	16.5 19.3	125.5 109.5	3.2 2.7	43.0 43.9	107.8 127.5	187.2 180.7	15.8 18.1	133.5 118.9	3.5 2.9	44.4 45.0
		60	77.9	215.3	9.2	183.8	6.8	54.7	72.3	222.0	9.4	189.9	6.9	59.4	69.5	228.7	9.6	196.1	7.0	61.8
		80	97.3	207.9	12.1	166.5	5.0	56.1	91.9	214.3	12.3	172.3	5.1	60.4	89.2	220.8	12.5	178.0	5.2	62.6
	24	100	116.7	200.4	15.0	149.2	3.9	57.6	111.5	206.7	15.3	154.6	4.0	61.4	108.9	212.9	15.5	160.0	4.0	63.3
		120	136.1	193.0	17.9	131.9	3.2	59.0	131.1	199.0	18.2	136.9	3.2	62.4	128.5	205.0	18.5	142.0	3.3	64.1
		60	78.5	221.7	10.2	186.7	6.3	54.4	72.7	228.5	10.4	193.0	6.4	59.3	69.8	235.4	10.6	199.3	6.5	61.7
		80	97.8	214.1	13.4	168.4	4.7	56.0	92.3	220.8	13.1	176.0	4.9	60.2	89.5	227.5	12.8	183.6	5.2	62.3
70	36	100	117.2	206.6	16.6	150.0	3.6	57.5	111.8	213.1	15.9	159.0	3.9	61.2	109.1	219.6	15.1	167.9	4.3	63.0
		120	136.6	199.1	19.8	131.6	3.0	59.0	131.4	205.4	18.6	141.9	3.2	62.1	128.8	211.7	17.4	152.3	3.6	63.7
		60	79.0	228.0	11.2	189.6	5.9	54.2	73.1	235.0	11.4	196.1	6.0	59.1	70.1	242.1	11.6	202.6	6.1	61.6
		80	98.4	220.4	14.7	170.2	4.4	55.8	92.6	227.3	13.9	179.7	4.8	60.0	89.8	234.2	13.2	189.2	5.2	62.1
	48	100	117.7	212.8	18.2	150.8	3.4	57.4	112.2	219.5	16.5	163.3	3.9	60.9	109.4	226.3	14.8	175.9	4.5	62.7
		120	137.1	205.2	21.6	131.4	2.8	59.1	131.8	211.8	19.0	147.0	3.3	61.8	129.1	218.4	16.4	162.5	3.9	63.2
		60	81.0	252.0	9.7	218.9	7.6	71.8	74.4	260.0	9.9	226.2	7.7	77.4	71.2	268.0	10.1	233.5	7.8	80.3
		80	100.3	243.3	12.7	199.9	5.6	73.3	94.0	251.2	12.9	207.0	5.7	78.5	90.8	259.0	13.1	214.2	5.8	81.1
	24	100																		
		120																		
		60	81.6	259.5	10.8	222.8	7.1	71.4	74.9	267.8	10.9	230.4	7.2	77.2	71.5	276.0	11.1	238.0	7.3	80.1
_	7.0	80	100.9	250.7	14.1	202.6	5.2	73.1	94.4	258.8	13.6	212.5	5.6	78.2	91.1	266.8	13.1	222.3	6.0	80.7
90	36	100	120.2	241.9	17.4	182.4	4.1	74.8	113.9	249.8	16.2	194.5	4.5	79.2	110.7	257.7	15.0	206.6	5.0	81.4
		120																		
		60	82.3	267.0	11.8	226.7	6.6	71.1	75.3	275.5	12.0	234.6	6.7	77.0	71.8	284.0	12.2	242.5	6.8	79.9
	48	80	101.5	258.1	15.5	205.3	4.9	72.9	94.8	266.4	14.2	217.9	5.5	77.9	91.4	274.7	13.0	230.4	6.2	80.4
	48	100	120.8	249.2	19.1	184.0	3.8	74.7	114.3	257.3	16.4	201.2	4.6	78.8	111.1	265.3	13.8	218.3	5.6	80.9
1		120																		

Operating Parameters

Heating Mode

Entering Load Temp (°F)	Entering Source Temp (°F)	Suction Pressure (psig)	Discharge Pressure (psig)	Superheat (°F)	Subcooling (°F)
	20	50-75	185-200	8-10	11-15
	30	75-100	200-215	10-12	10-13
60	50	100-125	200-215	12-14	8-12
	70	125-150	215-230	14-18	8-12
	90	150-175	230-255	25-30	8-12
	20	50-75	270-285	8-10	11-15
	30	75-100	285-300	10-12	10-13
80	50	100-125	300-315	12-14	8-12
	70	125-150	315-330	14-18	8-12
	90	150-175	330-345	25-30	8-12
	20	60-85	350-365	8-10	10-13
	30	85-110	365-380	10-12	7-11
100	50	110-135	385-400	12-14	7-11
	70	135-170	400-415	14-18	3-7
	90	170-205	415-430	25-30	3-7
	20	60-85	455-470	8-10	10-13
	30	85-110	470-485	10-12	7-11
120	50	110-135	485-500	12-14	7-11
	70	135-170	500-515	14-18	3-7
	90	170-205	525-550	25-30	3-7

NOTE: Operating data based on normal conditions with 3 gpm/tom for the load and source.

6/16/09

Cooling Mode

Entering Load Temp (°F)	Entering Source Temp (°F)	Suction Pressure (psig)	Discharge Pressure (psig)	Superheat (°F)	Subcooling (°F)
	30	80-90	140-175	15-20	3-6
	50	90-100	200-235	11-15	6-9
50	70	100-110	250-285	11-15	9-12
	90	110-120	330-365	8-12	12-14
	110	120-130	430-465	8-12	14-17
	30	80-90	150-185	15-20	3-6
70	50	90-100	210-245	11-15	6-9
70	70	100-110	260-295	11-15	9-12
	90	110-120	340-375	8-12	12-14
	30	80-90	150-185	15-20	3-6
•	50	90-100	210-245	11-15	6-9
90	70	100-110	260-295	11-15	9-12
	90	110-120	340-375	8-12	12-14
	30	90-100	160-195	40-45	3-6
110	50	110-130	220-255	30-40	6-9
110	70	150-170	305-335	30-40	9-12
	90	190-210	365-400	20-30	13-16

NOTE: Operating data based on normal conditions with 3 gpm/tom for the load and source.

6/16/09

Load and Source Pressure Drop

Madal	GPM	Pressure Drop (psi)								
Model		30°F	50°F	70°F	90°F	110°F				
	15	1.0	0.8	0.5	0.3	0.1				
100	23	2.5	2.2	2.0	1.7	1.3				
100	30	3.8	3.6	3.3	3.1	2.4				
	34	4.5	4.3	4.0	3.8	3.0				
	18	1.6	1.3	1.1	0.8	0.6				
120	28	3.4	3.2	2.9	2.7	2.1				
120	36	4.9	4.7	4.4	4.2	3.3				
	40	5.6	5.4	5.1	4.9	3.9				
	21	2.1	1.9	1.6	1.4	1.0				
150	32	4.2	3.9	3.7	3.4	2.7				
150	42	6.0	5.8	5.5	5.3	4.2				
	50	7.5	7.3	7.0	6.8	5.5				
	24	2.7	2.4	2.2	1.9	1.5				
180	36	4.9	4.7	4.4	4.2	3.3				
180	48	7.1	6.9	6.6	6.4	5.1				
	60	9.3	9.1	8.8	8.6	7.0				

3/9/09

Unit Startup

Verify the following:

- · High voltage is correct and matches nameplate
- Fuses, breakers and wire size are correct
- Low voltage wiring is complete
- · Piping is complete and the water system has been cleaned and flushed
- Air is purged from closed loop system
- Isolation valves are open and water control valves or loop pumps are wired
- Service/access panels are in place
- Transformer has been switched to lower voltage tap if needed (208/230 volt units only)
- · Unit controls are in "off" position
- · Flow switches are installed and ready
- Freeze detection setpoints have been set in the microprocessor



WARNING: Verify ALL water controls are open and allow water flow PRIOR to engaging the compressor. Failure to do so can result in freezing the heat exchanger or water lines causing permanent damage to the unit.

Startup Steps

- Set thermostat control above cooling setpoint.
- · Set thermostat control in cooling mode.
- Slowly reduce the control setting until both the compressor and water control valve/loop pumps are activated. Verify that the compressor is on and that the water flow rate is correct by measuring pressure drop through the heat exchanger and comparing to the Pressure Drop table. Check for correct rotation of scroll compressors. Switch any two power leads at the L1, L2, and L3 line voltage termination block if incorrect.
- Perform a cooling capacity test by multiplying GPM x ΔT x 485 (antifreeze/water). Use 500 for 100% water. Check capacity against catalog data at same conditions.
- · Set control to "OFF" position.
- · Leave unit "OFF" for approximately five (5) minutes to allow pressure to equalize.
- Adjust control below heating setpoint.
- Set control in "HEAT" position mode.
- Slowly increase the control setting until both compressor and water control valve/loop pumps are activated. The
 reversing valve should be heard changing over.
- Perform a heating capacity test by multiplying GPM x ΔT x 485 (antifreeze/water). Use 500 for 100% water. Check capacity against catalog data at same conditions.
- · Check for vibrations, noise and water leaks.
- Set system to maintain desired setpoint.
- Instruct the owner/operator of correct control and system operation.

Troubleshooting

Should a major problem develop, refer to the following information for possible causes and corrective steps.

If compressor won't run:

- The fuse may be open or the circuit breaker is tripped. Check electrical circuits and motor windings for shorts or grounds. Investigate for possible overloading. Replace fuse or reset circuit breakers after fault is corrected.
- 2. Supply voltage may be too low. Check it with a volt meter.
- 3. Control system may be faulty. Check control for correct wiring of thermostat or aquastat and check the 24 volt transformer for proper voltage.
- 4. Wires may be loose or broken. Replace or tighten.
- 5. The low pressure switch may have tripped due to one or more of the following:
 - a) Heating
 - 1) Plugged heat exchanger on source side
 - 2) Water flow source side (Low)
 - 3) Water too cold source side
 - 4) Low refrigerant
 - b) Cooling
 - 1) Plugged heat exchanger on load side
 - 2) Water flow load side (Low)
 - 3) Water too cold load side
 - 4) Low refrigerant
- 6. The high pressure switch may have tripped due to one or more of the following:
 - a) Heating
 - 1) Plugged heat exchanger on load side
 - 2) Low water flow load side
 - 3) Water too warm load side
 - b) Cooling
 - 1) Plugged heat exchanger on source side
 - 2) Low water flow on source side
 - 3) Water too warm source side
- 7. The compressor overload protection may be open. Disconnect power. Remove S1 and S2 wires from the compressor protection module. Measure the resistance between the S1 and S2 wires. If the resistance measures > 2750 ohms, then the internal compressor resistance has tripped the compressor protection module. The compressor protection module will reset after a 30 minute delay and the resistance measures < 2250 ohms. Cycling the power off for a minimum of 3 seconds will manually reset the compressor module. The internal compressor resistance must measure < 2250 ohms for the compressor module to reset.</p>
- 8. The internal winding of the compressor motor may be grounded to the compressor shell. If so, replace the compressor.
- 9. The compressor winding may be open or shorted. Disconnect power. Check continuity with ohm meter. If the winding is open, replace the compressor.

If sufficient cooling or heating is not obtained:

- 1. Check control for improper location or setting.
- 2. Check for restriction in water flow.
- 3. Check refrigerant subcooling and superheat for proper refrigerant charge and expansion valve operation.
- 4. The reversing valve may be defective and creating a bypass of refrigerant. If the unit will not heat, check the reversing valve coil.

If the unit operation is noisy:

- Check compressor for loosened mounting bolts. Make sure compressor is floating free on its isolator mounts. Check for tubing contact with the compressor or other surfaces. Readjust it by bending slightly.
- 2. Check screws on all panels.
- Check for chattering or humming in the contactor or relays due to low voltage or a defective holding coil. Replace the component.
- 4. Check for proper installation of vibration absorbing material under the unit.
- 5. Check for abnormally high discharge pressures.
- 6. Compressor rotation incorrect

Preventive Maintenance

Unit Heat Exchanger Maintenance

- 1. Keep all air out of the water or antifreeze solution.
- 2. Keep the system under pressure at all times. Closed loop systems must have positive static pressure or air vents may draw air into the system.

NOTES: If the installation is in an area with a known high mineral content in the water, it is best to establish with the owner a periodic maintenance schedule for checking the water-to-refrigerant heat exchanger on a regular basis. Should periodic cleaning be necessary, use standard cleaning procedures. Generally, the more water flowing through the unit, the less chance there is for scaling. Low GPM flow rates produce higher temperatures through the heat exchanger. To avoid excessive pressure drop and the possibility of metal erosion, do not exceed GPM flow rate as shown on the specification sheets for each unit.

Replacement Procedures

When contacting the company for service or replacement parts, refer to the model number and serial number of the unit as stamped on the serial plate attached to the unit. If replacement parts are required, mention the date of installation of the unit and the date of failure, along with an explanation of the malfunctions and a description of the replacement parts required.

In-Warranty Material Return

Material may not be returned except by permission of authorized warranty personnel. Contact your local distributor for warranty return authorization and assistance.

Service Parts List

Part Description		NDW100				NDW120			
		208- 230/60/1	208- 230/60/3	460/60/3	575/60/3	208- 230/60/3	208- 230/60/3	460/60/3	575/60/3
Refrigeration Components	Compressor	34P580-01	34P580-03	34P580-04	34P580-05	34P616-01	34P616-03	34P616-04	34P616-05
	Compressor Sound Jacket	92P504A05					92P5	19-02	
	Thermal Expansion Valve	33P608-18				33P605-12			
	Filter Dryer	36P500B02					36P50	00B02	
	Reversing Valve with Coil	33P526-04				33P526-04			
ا ي ت	Brazed Plate Heat Exchanger	62P565-01			62P565-01				
	Heat Exchanger Support Bracket		47F5	88-01		47F588-01			
\ <u>_</u> s	High Pressure Switch	35P506B02			35P506B02				
Safeties / Sensors	Low Pressure Switch	35P506B01				35P506B01			
afet	Water Temperature Sensor	12P529-04				12P529-04			
ا يق م	Low Water Coil Temp Sensor	/ater Coil Temp Sensor 12S529-01				12S529-01			
	Compressor Contactor	13P004A03		13P537B03		13P004A03		13P537B03	
=	Transformer	15P50	D1B01	15P505B01	15P506B01	15P50	O1B01	15P505B01	15P506B01
Electrical	Power In Terminal Block	12P524A01				12P524A01			
ect	Connection Block - Small		12P50	03-06		12P503-06			
□	Connection Block - Low Voltage		12P5	20-01		12P52O-01			
	Grounding Lug	12P004A			12P004A				
	FX10 Main Board - no communications	17X51606-09			17X51606-09				
	FX10 Main Board & N2 Open Com Card	17X51606-10			17X51606-10				
<u> </u>	FX10 Main Board & Lonworks Com Card	17X51606-12			17X51606-12				
Control	FX10 Main Board & BACnet Com Card	17X51606-11				17X51606-11			
၂ ပ	FX10 Expansion Board	xpansion Board 17P516-07				17P516-07			
	Display	19P563-01			19P563-01				
	FX10 Display Interface Board	17P516-11			17P516-11				
et	Side Access Panel	40C661-01			40C661-01				
	Front/Back Access Panel	40C662-01			40C662-01				
Cabinet	Top Panel (back mount)	42C547-01			42C547-01				
ပြီ	Top Panel - Large (top mount)	42C547-02			42C547-02				
	Top Panel - Small (top mount)	42C547-03			42C547-03				

05/06/09

Part Description		NDW150				NDW180			
		208- 230/60/3	208- 230/60/3	460/60/3	575/60/3	208- 230/60/3	208- 230/60/3	460/60/3	575/60/3
Refrigeration Components	Compressor	34P614-01	34P614-03	34P614-04	34P614-05	34P609-01	34P605-03	34P605-04	34P605-05
	Compressor Sound Jacket	92P519-02					92P5	19-02	
	Thermal Expansion Valve	33P605-13				33P605-14			
	Filter Dryer	36P500B02			36P500B02				
E E	Reversing Valve with Coil	33P526-04				33P5	26-04		
ا ي ت	Brazed Plate Heat Exchanger	62P565-01			62P565-01				
	Heat Exchanger Support Bracket	47F588-01				47F588-01			
\ s	High Pressure Switch	35P506B02				35P506B02			
Safeties / Sensors	Low Pressure Switch	35P506B01				35P506B01			
afe!	Water Temperature Sensor	12P529-04				12P529-04			
S o	Low Water Coil Temp Sensor		12S5	29-01		12S529-01			
	Compressor Contactor	13P004A03		13P537B03		13P004A03		13P537B03	
-	Transformer	15P501B01 15P505B01 15P506B01		15P501B01 15P505		15P505B01	15P506B01		
Electrical	Power In Terminal Block	12P524A01			12P524A01				
<u> </u>	Connection Block - Small	12P503-06			12P503-06				
ш	Connection Block - Low Voltage		12P5	20-01		12P52O-01			
	Grounding Lug		12PC	04A		12P004A			
	FX10 Main Board - no communications	17X51606-09			17X51606-09				
	FX10 Main Board & N2 Open Com Card	17X51606-10			17X51606-10				
<u></u>	FX10 Main Board & Lonworks Com Card	17X51606-12			17X51606-12				
Control	FX10 Main Board & BACnet Com Card 17X5		606-11		17X51606-11				
ඊ	FX10 Expansion Board	17P516-07 19P563-01				17P516-07			
	Display					19P563-01			
	FX10 Display Interface Board	17P516-11				17P516-11			
	Side Access Panel	ss Panel 40C661-01				40C661-01			
e e	Front/Back Access Panel	40C662-01			40C662-01				
Cabinet	Top Panel (back mount)	42C547-01			42C547-01				
ت	Top Panel - Large (top mount)	42C547-02			42C547-02				
	Top Panel - Small (top mount)	Small (top mount) 42C547-03			42C547-03				

05/06/09



Manufactured by WaterFurnace International, Inc. 9000 Conservation Way Fort Wayne, IN 46809 www.waterfurnace.com

NDWIM 08/09

Product: **Envision NDW**Type: Hydronic Unit
Size: 8-15 Ton

Document: Installation Manual